



Technical Information

Proline Promag W 10

Electromagnetic flowmeter



Flowmeter for basic water and wastewater applications with easy-to-use operation concept

Application

- The bidirectional measuring principle is virtually independent of pressure, density, temperature and viscosity
- Suitable for basic measuring tasks such as raw water infeed

Device properties

- International drinking water approvals
- Degree of protection IP68 (Type 6P enclosure)
- System integration with HART, Modbus RS485
- Flexible operation with app and optional display

Your benefits

- Reliable measurement at constant accuracy with 0 x DN run without pressure loss
- Flexible engineering – sensor with fixed or lap-joint process connections
- Application fitness – EN ISO 12944 corrosion protection for underground or underwater installation
- Improved plant availability – sensor compliant with industry-specific requirements
- Optimum usability – operation with mobile devices and SmartBlue app or display with touch screen
- Simple, time-saving commissioning – guided parameterization in advance and in the field
- Integrated verification – Heartbeat Technology

Table of contents

About this document	4	Vibration-resistance and shock-resistance	51
Symbols	4	Electromagnetic compatibility (EMC)	51
Associated documentation	4		
Ordering information	4		
Registered trademarks	6		
Function and system design	8	Process	54
Measuring principle	8	Medium temperature range	54
Product design	8	Conductivity	54
IT security	9	Flow limit	54
Device-specific IT security	10	Pressure-temperature ratings	56
		Pressure tightness	59
		Pressure loss	59
Input	12	Mechanical construction	62
Measured variable	12	Weight	62
Operable flow range	12	Measuring pipe specification	66
Measuring range	12	Materials	67
		Fitted electrodes	68
		Process connections	68
		Surface roughness	68
Output	18	Dimensions in SI units	72
Output versions	18	Compact version	72
Output signal	18	Remote version	78
Signal on alarm	21	Fixed flange	83
Low flow cut off	21	Lap joint flange	94
Galvanic isolation	21	Lap joint flange, stamped plate	97
Protocol-specific data	21	Accessories	98
Power supply	24	Dimensions in US units	102
Terminal assignment	24	Compact version	102
Supply voltage	24	Remote version	108
Power consumption	24	Fixed flange	113
Current consumption	24	Lap joint flange	115
Power supply failure	25	Accessories	116
Electrical connection	25		
Potential equalization	30	Local display	120
Terminals	32	Operating concept	120
Cable entries	32	Operating options	120
Overvoltage protection	33	Operating tools	121
Cable specification	36	Certificates and approvals	124
Requirements for connecting cable	36	Non-Ex approval	124
Ground cable requirements	36	Pressure Equipment Directive	124
Connecting cable requirements	37	Drinking water approval	124
		Pharmaceutical compatibility	124
Performance characteristics	40	HART certification	124
Reference operating conditions	40	Radio approval	124
Maximum measured error	40	Additional approvals	124
Repeatability	40	Other standards and guidelines	124
Influence of ambient temperature	40		
Installation	42	Application packages	128
Installation conditions	42	Use	128
		Heartbeat Verification + Monitoring	128
Environment	50	Accessories	130
Ambient temperature range	50	Device-specific accessories	130
Storage temperature	50	Communication-specific accessories	131
Relative humidity	50	Service-specific accessory	131
Operating height	50	System components	132
Atmosphere	50		
Degree of protection	50		

About this document

Symbols	4
Associated documentation	4
Ordering information	4
Registered trademarks	6

Symbols

Electronics

-  Direct current
-  Alternating current
-  Direct current and alternating current
-  Terminal connection for potential equalization

Types of information

-  Preferred procedures, processes or actions
-  Permitted procedures, processes or actions
-  Forbidden procedures, processes or actions
-  Additional information
-  Reference to documentation
-  Reference to page
-  Reference to graphic

Explosion protection

-  Hazardous area
-  Non-hazardous area

Associated documentation

Technical Information	Overview of the device with the most important technical data.
Operating Instructions	All the information that is required in the various phases of the life cycle of the device: from product identification, incoming acceptance and storage, to mounting, connection, operation and commissioning through to troubleshooting, maintenance and disposal as well as the technical data and dimensions.
Sensor Brief Operating Instructions	Incoming acceptance, transport, storage and mounting of the device.
Transmitter Brief Operating Instructions	Electrical connection and commissioning of the device.
Description of Parameters	Detailed explanation of the menus and parameters.
Safety Instructions	Documents for the use of the device in hazardous areas.
Special Documentation	Documents with more detailed information on specific topics.
Installation Instructions	Installation of spare parts and accessories.



The device documentation is available online on the device product page and in the Downloads area: www.endress.com

Ordering information

Detailed ordering information is available from your nearest sales organization www.addresses.endress.com or in the Product Configurator at www.endress.com:

1. Select the product using the filters and search field.
2. Open the product page.

3. Select **Configuration**.



Product Configurator - the tool for individual product configuration

- Up-to-the-minute configuration data
- Depending on the device: Direct input of measuring point-specific information such as measuring range or operating language
- Automatic verification of exclusion criteria
- Automatic creation of the order code and its breakdown in PDF or Excel output format
- Ability to order directly in the Endress+Hauser Online Shop

Registered trademarks

HART®

Registered trademark of the FieldComm Group, Austin, USA

Modbus®

Registered trademark of SCHNEIDER AUTOMATION, INC.

Bluetooth®

The Bluetooth word mark and Bluetooth logos are registered trademarks of Bluetooth SIG. Inc. and any use of such marks by Endress+Hauser is under license. Other trademarks and trade names are those of their respective owners.

Apple®

Apple, the Apple logo, iPhone, and iPod touch are trademarks of Apple Inc., registered in the U.S. and other countries. App Store is a service mark of Apple Inc.

Android®


Android, Google Play and the Google Play logo are trademarks of Google Inc.

Function and system design

Measuring principle	8
Product design	8
IT security	9
Device-specific IT security	10

Measuring principle

Following *Faraday's law of magnetic induction*, a voltage is induced in a conductor moving through a magnetic field.

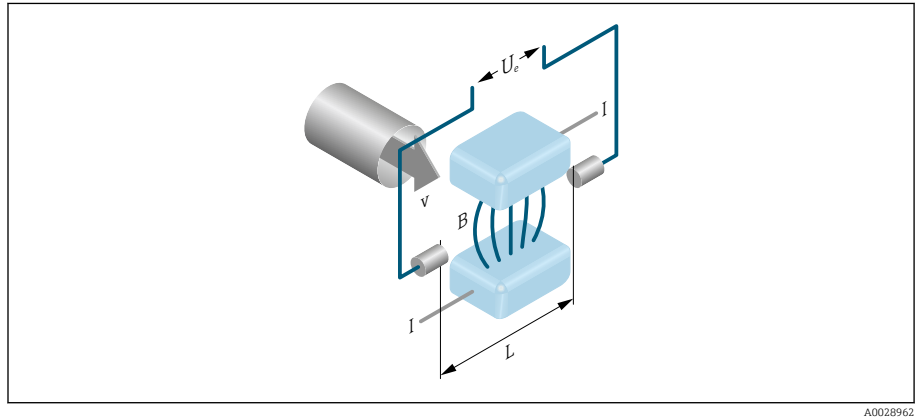

A0028962

- U_e Induced voltage
 B Magnetic induction (magnetic field)
 L Electrode spacing
 I Current
 v Flow velocity

In the electromagnetic measuring principle, the flowing medium is the moving conductor. The voltage induced (U_e) is proportional to the flow velocity (v) and is supplied to the amplifier by means of two measuring electrodes. The flow volume (Q) is calculated via the pipe cross-section (A). The DC magnetic field is generated by a switched direct current of alternating polarity.

Formulae for calculation

- Induced voltage $U_e = B \cdot L \cdot v$
- Volume flow $Q = A \cdot v$

Product design


The device consists of a transmitter and a sensor.

Two device versions are available:

- Compact version – transmitter and sensor form a mechanical unit.
- Remote version - transmitter and sensor are mounted in separate locations.

Compact version

The transmitter and sensor form a mechanical unit.

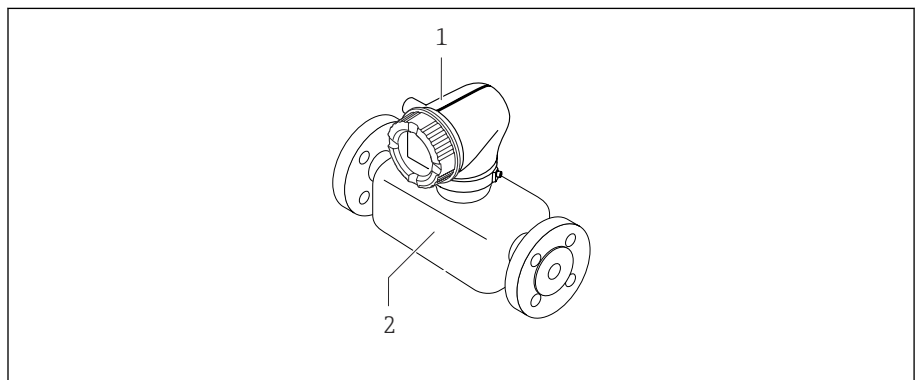


A0008262

- 1 Transmitter
 2 Sensor

Remote version





The transmitter and sensor are mounted in physically separate locations.

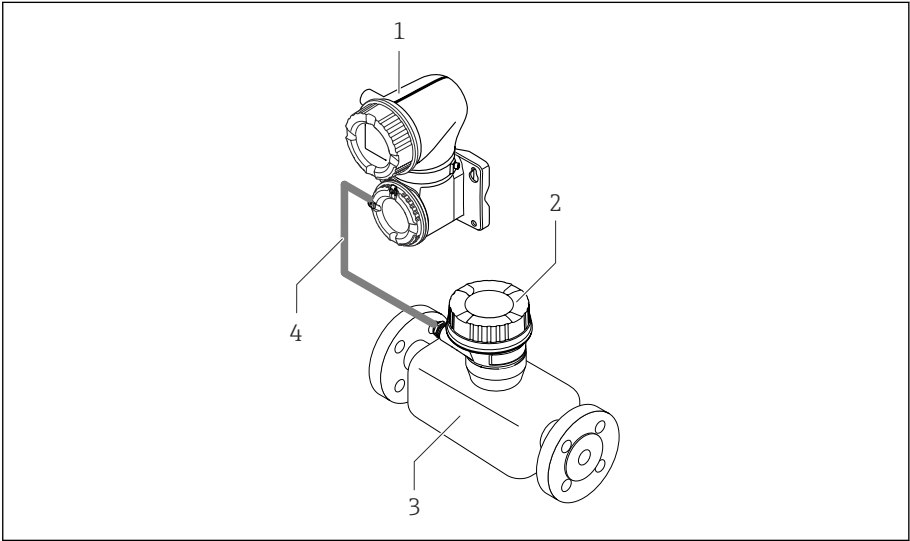

A0028196

- 1 Transmitter
- 2 Sensor connection housing
- 3 Sensor
- 4 Connecting cable

Measuring system

Proline 10 transmitter	Promag W sensor	
		
Compact version	DN 25 to 300 mm (1 to 12 in)	DN 25 to 300 mm (1 to 12 in)
		
Remote version	DN 350 to 3000 mm (14 to 120 in)	

IT security

We only provide a warranty if the device is installed and used as described in the Operating Instructions. The device is equipped with security mechanisms to protect it against any inadvertent changes to the device settings.

IT security measures in line with operators' security standards and designed to provide additional protection for the device and device data transfer must be implemented by the operators themselves.

Device-specific IT security

Access via Bluetooth

Secure signal transmission via Bluetooth uses an encryption method tested by the Fraunhofer Institute.

- Without the SmartBlue App, the device is not visible via Bluetooth.
- Only one point-to-point connection is established between the device and a smartphone or tablet.

Access via the SmartBlue app

Two access levels (user roles) are defined for the device: the **Operator** user role and the **Maintenance** user role. The **Maintenance** user role is configured when the device leaves the factory.

If a user-specific access code is not defined (in the Enter access code parameter), the default setting **0000** continues to apply and the **Maintenance** user role is automatically enabled. The device's configuration data are not write-protected and can be edited at all times.

If a user-specific access code has been defined (in the Enter access code parameter), all the parameters are write-protected. The device is accessed with the **Operator** user role. When the user-specific access code is entered a second time, the **Maintenance** user role is enabled. All parameters can be written to.



For detailed information, see the "Description of Device Parameters" document pertaining to the device.

Protecting access via a password

There are a variety of ways to protect against write access to the device parameters:

- User-specific access code:
Protect write access to the device parameters via all the interfaces.
- Bluetooth key:
The password protects access and the connection between an operating unit, e.g. a smartphone or tablet, and the device via the Bluetooth interface.

General notes on the use of passwords

- The access code and Bluetooth key that are valid when the device is delivered must be redefined during commissioning.
- Follow the general rules for generating a secure password when defining and managing the access code and Bluetooth key.
- The user is responsible for the management and careful handling of the access code and Bluetooth key.

Write protection switch

The entire operating menu can be locked via the write protection switch. The values of the parameters cannot be changed. Write protection is disabled when the device leaves the factory.

Write protection is enabled with the write protection switch on the back of the display module.

Input

Measured variable	12
Operable flow range	12
Measuring range	12

Measured variable

Direct measured variables	■ Volume flow (proportional to induced voltage) ■ Conductivity (order code for "Sensor Option", option CX)
Calculated measured variables	Mass flow

Operable flow range

Over 1000 : 1

Measuring range

Typically $v = 0.01$ to 10 m/s (0.03 to 33 ft/s) with specified measuring accuracy

Electrical conductivity:

- ≥ 5 $\mu\text{S/cm}$ for liquids in general
- ≥ 20 $\mu\text{S/cm}$ for demineralized water

Flow characteristic values in SI units: DN 25 to 125 (1 to 4")

Nominal diameter		Recommended flow	Factory settings		
		min./max. full scale value ($v \sim 0.3/10$ m/s)	Full scale value current output ($v \sim 2.5$ m/s)	Pulse value (~ 2 pulse/s)	Low flow cut off ($v \sim 0.04$ m/s)
[mm]	[in]	[dm ³ /min]	[dm ³ /min]	[dm ³]	[dm ³ /min]
25	1	9 to 300	75	0.5	1
32	–	15 to 500	125	1	2
40	1 ½	25 to 700	200	1.5	3
50	2	35 to 1 100	300	2.5	5
65	–	60 to 2 000	500	5	8
80	3	90 to 3 000	750	5	12
100	4	145 to 4 700	1200	10	20
125	–	220 to 7 500	1850	15	30

Flow characteristic values in SI units: DN 150 to 3000 (6 to 120")

Nominal diameter		Recommended flow	Factory settings		
		min./max. full scale value ($v \sim 0.3/10$ m/s)	Full scale value current output ($v \sim 2.5$ m/s)	Pulse value (~ 2 pulse/s)	Low flow cut off ($v \sim 0.04$ m/s)
[mm]	[in]	[m ³ /h]	[m ³ /h]	[m ³]	[m ³ /h]
150	6	20 to 600	150	0.025	2.5
200	8	35 to 1 100	300	0.05	5
250	10	55 to 1 700	500	0.05	7.5
300	12	80 to 2 400	750	0.1	10
350	14	110 to 3 300	1000	0.1	15
375	15	140 to 4 200	1200	0.15	20
400	16	140 to 4 200	1200	0.15	20
450	18	180 to 5 400	1500	0.25	25
500	20	220 to 6 600	2000	0.25	30
600	24	310 to 9 600	2500	0.3	40

Nominal diameter		Recommended flow	Factory settings		
		min./max. full scale value (v ~ 0.3/10 m/s)	Full scale value current output (v ~ 2.5 m/s)	Pulse value (~ 2 pulse/s)	Low flow cut off (v ~ 0.04 m/s)
[mm]	[in]	[m³/h]	[m³/h]	[m³]	[m³/h]
700	28	420 to 13 500	3500	0.5	50
750	30	480 to 15 000	4000	0.5	60
800	32	550 to 18 000	4500	0.75	75
900	36	690 to 22 500	6000	0.75	100
1000	40	850 to 28 000	7000	1	125
–	42	950 to 30 000	8000	1	125
1200	48	1 250 to 40 000	10 000	1.5	150
–	54	1 550 to 50 000	13 000	1.5	200
1400	–	1 700 to 55 000	14 000	2	225
–	60	1 950 to 60 000	16 000	2	250
1600	–	2 200 to 70 000	18 000	2.5	300
–	66	2 500 to 80 000	20 500	2.5	325
1800	72	2 800 to 90 000	23 000	3	350
–	78	3 300 to 100 000	28 500	3.5	450
2000	–	3 400 to 110 000	28 500	3.5	450
–	84	3 700 to 125 000	31 000	4.5	500
2200	–	4 100 to 136 000	34 000	4.5	540
–	90	4 300 to 143 000	36 000	5	570
2400	–	4 800 to 162 000	40 000	5.5	650
–	96	5 000 to 168 000	42 000	6	675
–	102	5 700 to 190 000	47 500	7	750
2600	–	5 700 to 191 000	48 000	7	775
–	108	6 500 to 210 000	55 000	7	850
2800	–	6 700 to 222 000	55 500	8	875
–	114	7 100 to 237 000	59 500	8	950
3000	–	7 600 to 254 000	63 500	9	1025
–	120	7 900 to 263 000	65 500	9	1050

Flow characteristic values in US units: 1 to 48" (DN 25 to 1200)

Nominal diameter		Recommended flow	Factory settings		
		min./max. full scale value (v ~ 0.3/10 m/s)	Full scale value current output (v ~ 2.5 m/s)	Pulse value (~ 2 pulse/s)	Low flow cut off (v ~ 0.04 m/s)
[in]	[mm]	[gal/min]	[gal/min]	[gal]	[gal/min]
1	25	2.5 to 80	18	0.2	0.25
–	32	4 to 130	30	0.2	0.5
1 ½	40	7 to 185	50	0.5	0.75
2	50	10 to 300	75	0.5	1.25
–	65	16 to 500	130	1	2

Nominal diameter		Recommended flow	Factory settings		
		min./max. full scale value (v ~ 0.3/10 m/s)	Full scale value current output (v ~ 2.5 m/s)	Pulse value (~ 2 pulse/s)	Low flow cut off (v ~ 0.04 m/s)
[in]	[mm]	[gal/min]	[gal/min]	[gal]	[gal/min]
3	80	24 to 800	200	2	2.5
4	100	40 to 1250	300	2	4
–	125	60 to 1950	450	5	7
6	150	90 to 2650	600	5	12
8	200	155 to 4850	1200	10	15
10	250	250 to 7500	1500	15	30
12	300	350 to 10600	2400	25	45
14	350	500 to 15000	3600	30	60
15	375	600 to 19000	4800	50	60
16	400	600 to 19000	4800	50	60
18	450	800 to 24000	6000	50	90
20	500	1000 to 30000	7500	75	120
24	600	1400 to 44000	10500	100	180
28	700	1900 to 60000	13500	125	210
30	750	2150 to 67000	16500	150	270
32	800	2450 to 80000	19500	200	300
36	900	3100 to 100000	24000	225	360
40	1000	3800 to 125000	30000	250	480
42	–	4200 to 135000	33000	250	600
48	1200	5500 to 175000	42000	400	600

Flow characteristic values in US units: 54 to 120" (DN 1400 to 3000)

Nominal diameter		Recommended flow	Factory settings		
		min./max. full scale value (v ~ 0.3/10 m/s)	Full scale value current output (v ~ 2.5 m/s)	Pulse value (~ 2 pulse/s)	Low flow cut off (v ~ 0.04 m/s)
[in]	[mm]	[Mgal/d]	[Mgal/d]	[Mgal]	[Mgal/d]
54	–	9 to 300	75	0.0005	1.3
–	1400	10 to 340	85	0.0005	1.3
60	–	12 to 380	95	0.0005	1.3
–	1600	13 to 450	110	0.0008	1.7
66	–	14 to 500	120	0.0008	2.2
72	1800	16 to 570	140	0.0008	2.6
78	–	18 to 650	175	0.0010	3.0
–	2000	20 to 700	175	0.0010	2.9
84	–	24 to 800	190	0.0011	3.2
–	2200	26 to 870	210	0.0012	3.4
90	–	27 to 910	220	0.0013	3.6
–	2400	31 to 1030	245	0.0014	4.1

Nominal diameter		Recommended flow	Factory settings		
		min./max. full scale value (v ~ 0.3/10 m/s)	Full scale value current output (v ~ 2.5 m/s)	Pulse value (~ 2 pulse/s)	Low flow cut off (v ~ 0.04 m/s)
[in]	[mm]	[Mgal/d]	[Mgal/d]	[Mgal]	[Mgal/d]
96	–	32 to 1066	265	0.0015	4.0
102	–	34 to 1203	300	0.0017	5.0
–	2600	34 to 1212	305	0.0018	5.0
108	–	35 to 1300	340	0.0020	5.0
–	2800	42 to 1405	350	0.0020	6.0
114	–	45 to 1503	375	0.0022	6.0
–	3000	48 to 1613	405	0.0023	6.0
120	–	50 to 1665	415	0.0024	7.0

Output

Output versions	18
Output signal	18
Signal on alarm	21
Low flow cut off	21
Galvanic isolation	21
Protocol-specific data	21

Output versions

Order code for 020: output; input	Output version
Option B	■ Current output 4 to 20 mA HART ■ Pulse/frequency/switch output
Option M	■ Modbus RS485 ■ Current output 4 to 20 mA

Output signal

Current output 4 to 20 mA HART / 4 to 20 mA HART Ex-i

Signal mode	Choose via terminal assignment: ■ Active ■ Passive
Current range	Can be set to: ■ 4 to 20 mA NAMUR ■ 4 to 20 mA US ■ 4 to 20 mA ■ Fixed current
Max. output current	21.5 mA
Open-circuit voltage	DC < 28.8 V (active)
Max. input voltage	DC 30 V (passive)
Max. load	400 Ω
Resolution	1 µA
Damping	Configurable: 0 to 999.9 s
Assignable measured variables	■ Off ■ Volume flow ■ Mass flow ■ Conductivity* ■ Noise* ■ Coil current shot time* * Visibility depends on order options or device settings

Modbus RS485

Physical interface	RS485 in accordance with EIA/TIA-485 standard
--------------------	---

Current output 4 to 20 mA

Signal mode	Choose via terminal assignment: ■ Active ■ Passive
Current range	Can be set to: ■ 4 to 20 mA NAMUR ■ 4 to 20 mA US ■ 4 to 20 mA ■ Fixed current
Max. output current	21.5 mA
Open-circuit voltage	DC < 28.8 V (active)
Max. input voltage	DC 30 V (passive)

Max. load	400 Ω
Resolution	1 μ A
Damping	Configurable: 0 to 999.9 s
Assignable measured variables	■ Off ■ Volume flow ■ Mass flow ■ Conductivity* ■ Noise* ■ Coil current shot time* * Visibility depends on order options or device settings

Pulse/frequency/switch output

Function	Can be set to: ■ Pulse output ■ Frequency output ■ Switch output
Version	Open collector: Passive
Input values	■ DC 10.4 to 30 V ■ Max. 140 mA
Voltage drop	■ $\leq$ DC 2 V @ 100 mA ■ $\leq$ DC 2.5 V @ max. input current

Pulse output	
Pulse width	Configurable: 0.05 to 2 000 ms
Max. pulse rate	10 000 Impulse/s
Pulse value	Configurable
Assignable measured variables	■ Volume flow ■ Mass flow

Frequency output	
Output frequency	Configurable: end value frequency 2 to 10 000 Hz ($f_{\max} = 12\,500$ Hz)
Damping	Configurable: 0 to 999.9 s
Pulse/pause ratio	1:1
Assignable measured variables	■ Off ■ Volume flow ■ Mass flow ■ Conductivity* ■ Noise* ■ Coil current shot time* ■ Reference electrode potential against PE* * Visibility depends on order options or device settings

Switch output	
Switching behavior	Binary, conductive or non-conductive
Switching delay	Configurable: 0 to 100 s

Number of switching cycles	Unlimited
Assignable functions	■ Off ■ On ■ Diagnostic behavior: ■ Alarm ■ Warning ■ Warning and alarm ■ Limit value: ■ Off ■ Volume flow ■ Mass flow ■ Flow velocity ■ Conductivity* ■ Corrected conductivity* ■ Totalizer 1...3 ■ Flow direction monitoring ■ Status ■ Empty pipe detection ■ Low flow cut off * Visibility depends on order options or device settings

Signal on alarm

Output behavior in the event of a device alarm (failure mode)

HART

Device diagnostics	Device condition can be read out via HART Command 48
--------------------	--

Modbus RS485

Failure mode	Selectable: ▪ NaN value instead of current value ▪ Last valid value
--------------	--

Current output 4 to 20 mA

4 to 20 mA	Selectable: ▪ Min. value: 3.59 mA ▪ Max. value: 21.5 mA ▪ Freely definable value between: 3.59 to 21.5 mA ▪ Actual value ▪ Last valid value
------------	---

Pulse/frequency/switch output

Pulse output	Selectable: ▪ Actual value ▪ No pulses
Frequency output	Selectable: ▪ Actual value ▪ 0 Hz ▪ Defined value: 0 to 12 500 Hz
Switch output	Selectable: ▪ Current status ▪ Open ▪ Closed

Low flow cut off

The switch points for low flow cut off are user-selectable.

Galvanic isolation

The outputs are galvanically isolated from one another and from earth.

Protocol-specific data

HART

Bus structure	The HART signal overlays the 4 to 20 mA current output.
Manufacturer ID	0x11
Device type ID	0x71
HART protocol revision	7
Device description files (DTM, DD)	Information and files under: www.endress.com

HART load	At least 250 Ω
System integration	Measured variables via HART protocol

Modbus RS485

Physical interface	RS485 in accordance with EIA/TIA-485 standard
Terminating resistor	Not integrated
Protocol	Modbus Applications Protocol Specification V1.1
Response times	▪ Direct data access: typically 25 to 50 ms ▪ Auto-scan buffer (data range): typically 3 to 5 ms
Device type	Slave
Slave address range	1 to 247
Broadcast address range	0
Function codes	▪ 03: Read holding register ▪ 04: Read input register ▪ 06: Write single registers ▪ 08: Diagnostics ▪ 16: Write multiple registers ▪ 23: Read/write multiple registers
Broadcast messages	Supported by the following function codes: ▪ 06: Write single registers ▪ 16: Write multiple registers ▪ 23: Read/write multiple registers
Supported baud rate	▪ 1 200 BAUD ▪ 2 400 BAUD ▪ 4 800 BAUD ▪ 9 600 BAUD ▪ 19 200 BAUD ▪ 38 400 BAUD ▪ 57 600 BAUD ▪ 115 200 BAUD
Data transfer mode	RTU
Data access	Each parameter can be accessed via Modbus RS485.  For Modbus register information
System integration	Information on system integration . ▪ Modbus RS485 information ▪ Function codes ▪ Register information ▪ Response time ▪ Modbus data map

Power supply

Terminal assignment	24
Supply voltage	24
Power consumption	24
Current consumption	24
Power supply failure	25
Electrical connection	25
Potential equalization	30
Terminals	32
Cable entries	32
Overvoltage protection	33

Terminal assignment



The terminal assignment is documented on an adhesive label.

The following terminal assignment is available:

Current output 4 to 20 mA HART (active) and pulse/frequency/switch output

Supply voltage		Output 1				Output 2	
1 (+)	2 (-)	26 (+)	27 (-)	24 (+)	25 (-)	22 (+)	23 (-)
L/+	N/-	Current output 4 to 20 mA HART (active)		-		Pulse/frequency/switch output (passive)	

Current output 4 to 20 mA HART (passive) and pulse/frequency/switch output

Supply voltage		Output 1				Output 2	
1 (+)	2 (-)	26 (+)	27 (-)	24 (+)	25 (-)	22 (+)	23 (-)
L/+	N/-	-		Current output 4 to 20 mA HART (passive)		Pulse/frequency/switch output (passive)	

Modbus RS485 and current output 4 to 20 mA (active)

Supply voltage		Output 1				Output 2	
1 (+)	2 (-)	26 (+)	27 (-)	24 (+)	25 (-)	22 (B)	23 (A)
L/+	N/-	Current output 4 to 20 mA (active)		-		Modbus RS485	

Modbus RS485 and current output 4 to 20 mA (passive)

Supply voltage		Output 1				Output 2	
1 (+)	2 (-)	26 (+)	27 (-)	24 (+)	25 (-)	22 (B)	23 (A)
L/+	N/-	-		Current output 4 to 20 mA (passive)		Modbus RS485	

Supply voltage

Order code for "Power supply"	Terminal voltage		Frequency range
Option D	DC 24 V	-20 to +30 %	-
Option E	AC 100 to 240 V	-15 to +10 %	50/60 Hz, ±5 Hz
Option I	DC 24 V	-20 to +30 %	-
	AC 100 to 240 V	-15 to +10 %	50/60 Hz, ±5 Hz
Option M non-hazardous area	DC 24 V	-20 to +30 %	-
	AC 100 to 240 V	-15 to +10 %	50/60 Hz, ±5 Hz

Power consumption

- Transmitter: max. 10 W (active power)
- Switch-on current: max. 36 A (< 5 ms) as per NAMUR Recommendation NE 21

Current consumption


- Max. 400 mA (24 V)
- Max. 200 mA (110 V, 50/60 Hz; 230 V, 50/60 Hz)

Power supply failure

- Totalizers stop at the last value measured.
- Device configuration remains unchanged.
- Error messages (incl. total operated hours) are stored.

Electrical connection

Connections and terminal assignment, remote version connecting cable

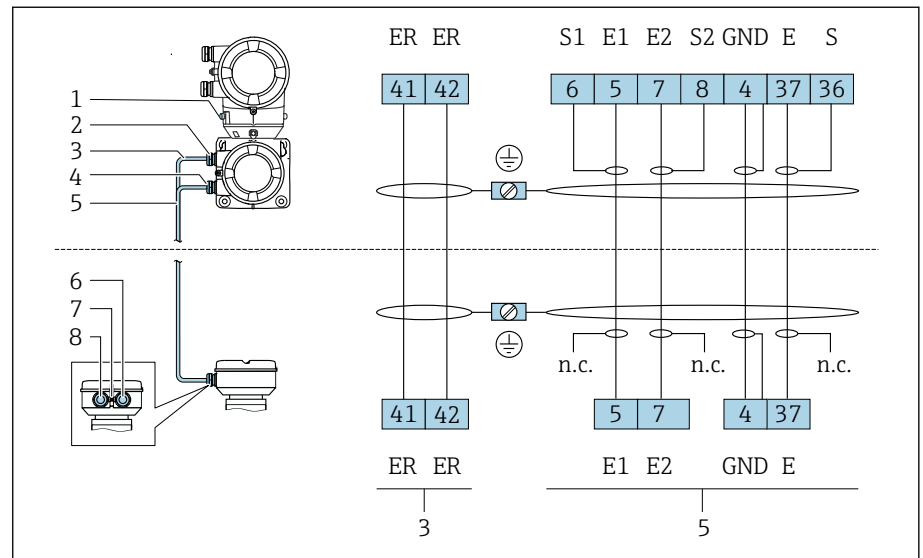


A0043474

- 1 Ground terminal, outer
- 2 Transmitter housing: cable entry for coil current cable
- 3 Coil current cable
- 4 Transmitter housing: cable entry for electrode cable
- 5 Electrode cable
- 6 Sensor connection housing: cable entry for electrode cable
- 7 Ground terminal, outer
- 8 Sensor connection housing: cable entry for coil current cable


Transmitter terminal connections

i Terminal assignment → *Terminal assignment*, 24

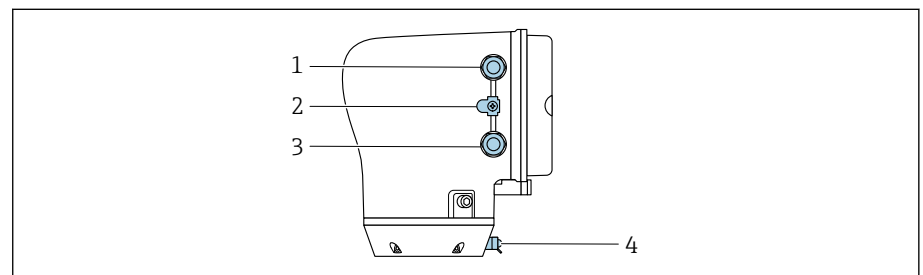

A0043283

- 1 Cable entry for power supply cable: supply voltage
- 2 Outer ground terminal: on transmitters made of polycarbonate with a metal pipe adapter
- 3 Cable entry for signal cable
- 4 Outer ground terminal

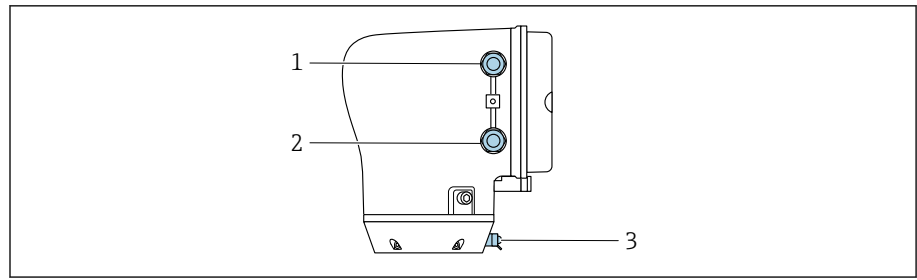


A0045438

- 1 Cable entry for power supply cable: supply voltage
- 2 Cable entry for signal cable
- 3 Outer ground terminal

Examples for electric terminals


Current output 4 to 20 mA HART (active)

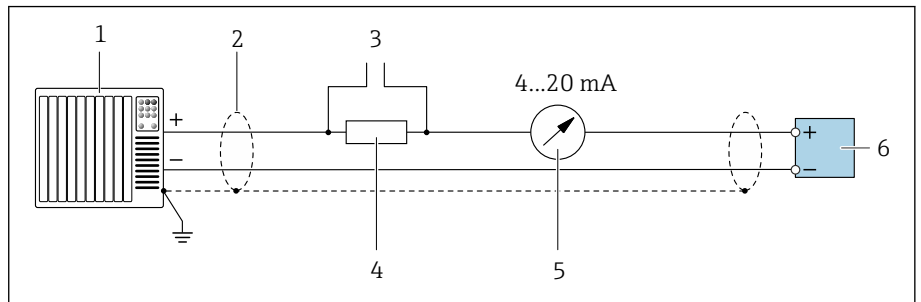

A0029055


- 1 Automation system with current input (e.g. PLC)
- 2 Cable shield
- 3 Connection for HART operating devices
- 4 Resistor for HART communication ($\geq 250 \Omega$): observe max. load
- 5 Analog display unit: observe max. load.
- 6 Transmitter

Current output 4 to 20 mA HART (passive)

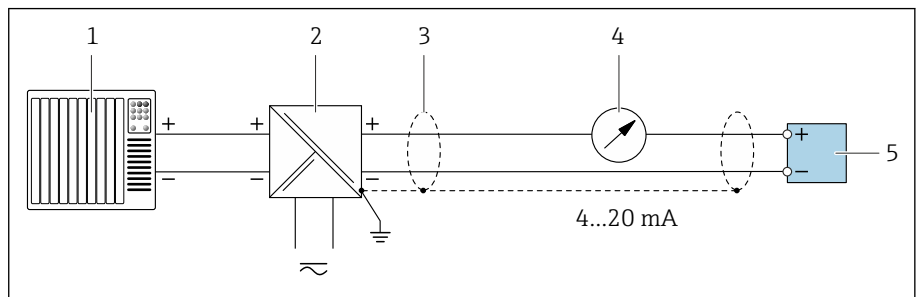

A0028762


- 1 Automation system with current input (e.g. PLC)
- 2 Active barrier for supply voltage (e.g. RN221N)
- 3 Cable shield
- 4 Analog display unit: observe max. load
- 5 Transmitter

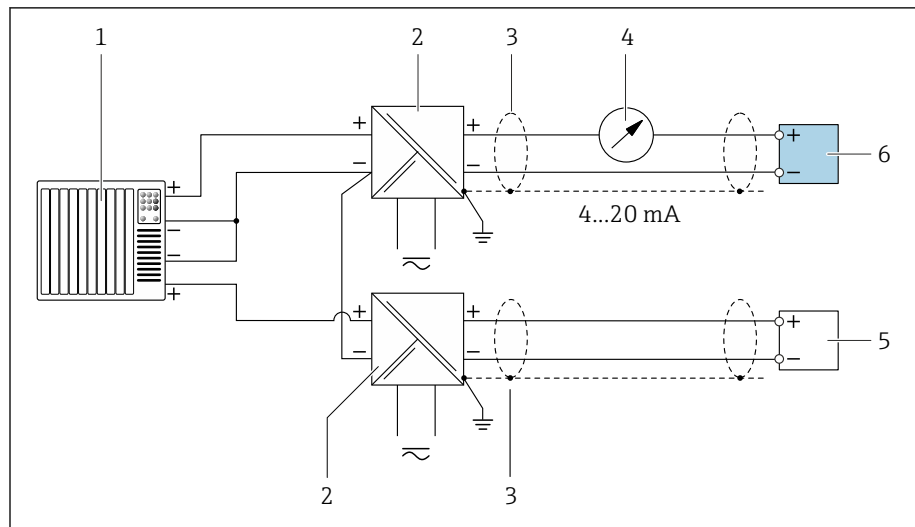HART input (passive)

A0028763

1 Connection example for HART input with a common negative (passive)

- 1 Automation system with current input (e.g. PLC)
- 2 Active barrier for supply voltage (e.g. RN221N)
- 3 Cable shield
- 4 Analog display unit: observe max. load
- 5 Pressure transmitter (e.g. Cerabar M, Cerabar S: see requirements)
- 6 Transmitter

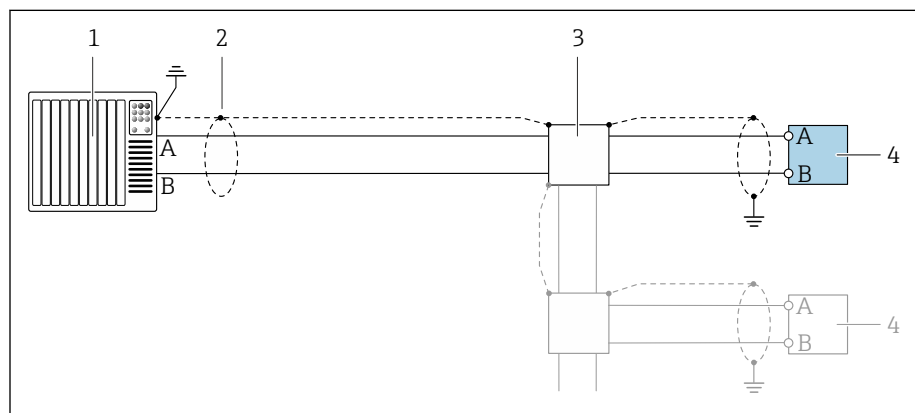
Modbus RS485

A0028765

2 Connection example for Modbus RS485, non-hazardous area and Zone 2; Class I, Division 2

- 1 Control system (e.g. PLC)
- 2 Cable shield
- 3 Distribution box
- 4 Transmitter


Current output 4 to 20 mA (active)

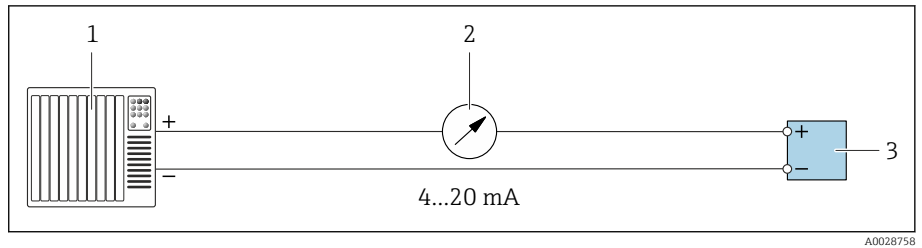

A0028758

- 1 Automation system with current input (e.g. PLC)
- 2 Analog display unit: observe max. load
- 3 Transmitter


Current output 4 to 20 mA (passive)

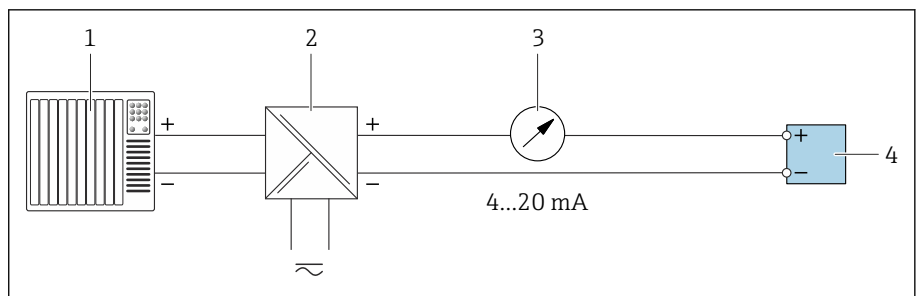

A0028759


- 1 Automation system with current input (e.g. PLC)
- 2 Active barrier for supply voltage (e.g. RN221N)
- 3 Analog display unit: observe max. load
- 4 Transmitter

Pulse/frequency output (passive)

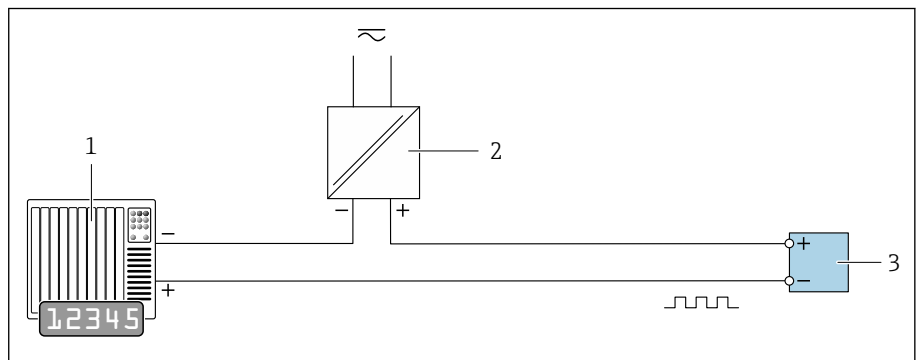

A0028761

- 1 Automation system with pulse output and frequency input (e.g. PLC with a 10 kΩ pull-up or pull-down resistor)
- 2 Supply voltage
- 3 Transmitter: observe input values

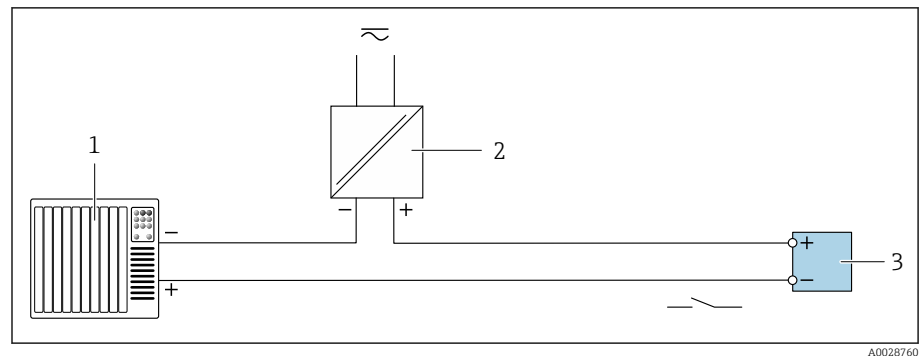Switch output (passive)

- 1 Automation system with switch input (e.g. PLC with a 10 kΩ pull-up or pull-down resistor)
- 2 Supply voltage
- 3 Transmitter: observe input values

Potential equalization**Introduction**

Correct potential equalization (equipotential bonding) is a prerequisite for stable and reliable flow measurement. Inadequate or incorrect potential equalization can result in device failure and present a safety hazard.

The following requirements must be observed to ensure correct, trouble-free measurement:

- The principle that the medium, the sensor and the transmitter must be at the same electrical potential applies.
- Take in-company grounding guidelines, materials and the grounding conditions and potential conditions of the pipe into consideration.
- The necessary potential equalization connections must be established using a ground cable with a minimum cross-section of 6 mm² (0.0093 in²). Also use a cable lug.
- In the case of remote device versions, the ground terminal in the example always refers to the sensor and not to the transmitter.



Accessories such as ground cables and ground disks can be ordered from Endress +Hauser → *Device-specific accessories*, 130

Abbreviations used


- PE (Protective Earth): potential at the potential equalization terminals of the device
- P_p (Potential Pipe): potential of the pipe, measured at the flanges
- P_M (Potential Medium): potential of the medium


Connection examples for standard situations**Unlined and grounded metal pipe**

- Potential equalization is via the measuring pipe.
- The medium is set to ground potential.

Starting conditions:

- Pipes are correctly grounded on both sides.
- Pipes are conductive and at the same electrical potential as the medium
- ▶ Connect the connection housing of the transmitter or sensor to ground potential via the ground terminal provided for this purpose.

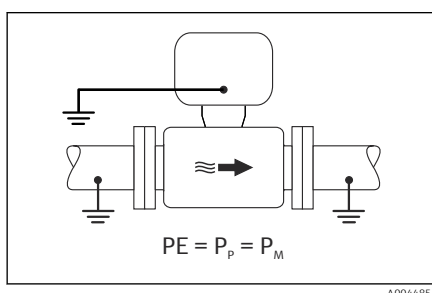

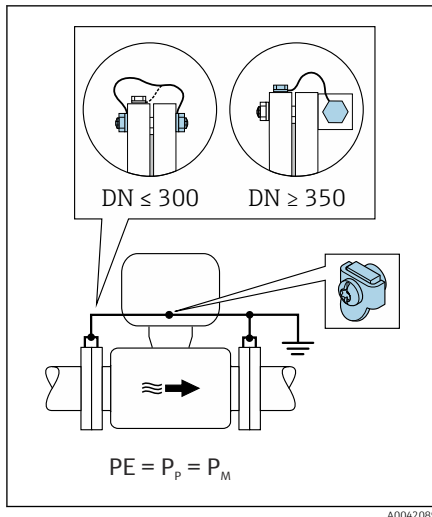


Unlined metal pipe

- Potential equalization is via the ground terminal and pipe flanges.
- The medium is set to ground potential.

Starting conditions:

- Pipes are not sufficiently grounded.
- Pipes are conductive and at the same electrical potential as the medium

1. Connect both sensor flanges to the pipe flange via a ground cable and ground them.
2. Connect the connection housing of the transmitter or sensor to ground potential via the ground terminal provided for this purpose.
3. For DN ≤ 300 (12"): Mount the ground cable directly on the conductive flange coating of the sensor with the flange screws.
4. For DN ≥ 350 (14"): Mount the ground cable directly on the metal transport bracket. Observe the screw tightening torques: see the Brief Operating Instructions for the sensor.

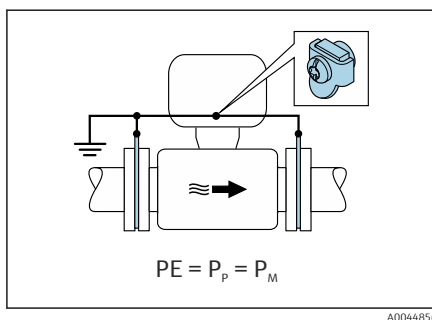

Plastic pipe or pipe with insulating liner

- Potential equalization is via the ground terminal and ground disks.
- The medium is set to ground potential.


Starting conditions:

- The pipe has an insulating effect.
- Low-impedance medium grounding close to the sensor is not guaranteed.
- Equalizing currents through the medium cannot be ruled out.

1. Connect the ground disks via the ground cable to the ground terminal of the connection housing of the transmitter or sensor.
2. Connect the connection to ground potential.

Connection example with the potential of medium not equal to potential equalization connection without the "Floating measurement" option

In these cases, the medium potential can differ from the potential of the device.

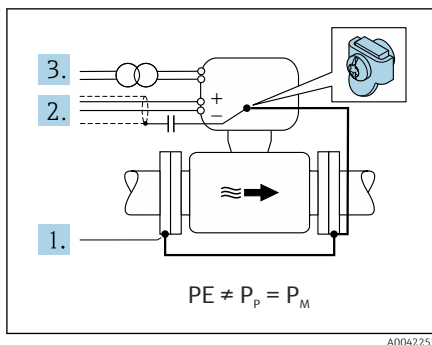

Metal, ungrounded pipe

The sensor and transmitter are installed in a way that provides electrical insulation from PE, e.g. applications for electrolytic processes or systems with cathodic protection.

Starting conditions:

- Unlined metal pipe
- Pipes with an electrically conductive liner

1. Connect the pipe flanges and transmitter via the ground cable.
2. Route the shielding of the signal lines via a capacitor (recommended value 1.5μF/50V).
3. Device connected to power supply such that it is floating in relation to the potential equalization connection (isolation transformer). This measure is not required in the case of 24V DC supply voltage without PE (= SELV power unit).

Connection examples with the potential of medium not equal to potential equalization connection with the "Floating measurement" option

In these cases, the medium potential can differ from the potential of the device.

Introduction

The "Floating measurement" option enables the galvanic isolation of the measuring system from the device potential. This minimizes harmful equalizing currents caused by


differences in potential between the medium and the device. The "Floating measurement" option is optionally available: order code for "Sensor option", option CV

Operating conditions for the use of the "Floating measurement" option

Device version	Compact version and remote version (length of connecting cable ≤ 10 m)
Differences in voltage between medium potential and device potential	As small as possible, usually in the mV range
Alternating voltage frequencies in the medium or at ground potential (PE)	Below typical power line frequency in the country

i To achieve the specified conductivity measuring accuracy, a conductivity calibration is recommended when the device is installed.

A full pipe adjustment is recommended when the device is installed.

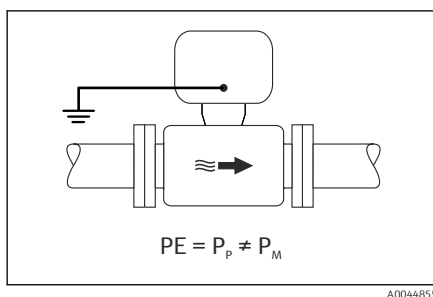


Plastic pipe

Sensor and transmitter are correctly grounded. A difference in potential can occur between the medium and potential equalization connection. Potential equalization between P_M and PE via the reference electrode is minimized with the "Floating measurement" option.

Starting conditions:

- The pipe has an insulating effect.
- Equalizing currents through the medium cannot be ruled out.

1. Use the "Floating measurement" option, while also observing the operating conditions for floating measurement.
2. Connect the connection housing of the transmitter or sensor to ground potential via the ground terminal provided for this purpose.

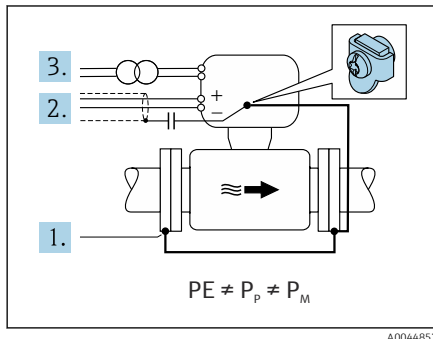

Metal, ungrounded pipe with insulating liner

The sensor and transmitter are installed in a way that provides electrical insulation from PE. The medium and pipe have different potentials. The "Floating measurement" option minimizes harmful equalizing currents between P_M and P_p via the reference electrode.

Starting conditions:

- Metal pipe with insulating liner
- Equalizing currents through the medium cannot be ruled out.

1. Connect the pipe flanges and transmitter via the ground cable.
2. Route the shielding of the signal cables via a capacitor (recommended value 1.5μF/50V).
3. Device connected to power supply such that it is floating in relation to the potential equalization connection (isolation transformer). This measure is not required in the case of 24V DC supply voltage without PE (= SELV power unit).
4. Use the "Floating measurement" option, while also observing the operating conditions for floating measurement.

Terminals

Spring terminals

- Suitable for strands and strands with ferrules.
- Conductor cross-section 0.2 to 2.5 mm² (24 to 12 AWG).

Cable entries

- Cable gland: M20 × 1.5 for cable Ø6 to 12 mm (0.24 to 0.47 in)
- Thread for cable entry:
 - NPT ½"
 - G ½", G ½" Ex d
 - M20

Overvoltage protection

Mains voltage fluctuations	→ Supply voltage, 24
Overvoltage category	Overvoltage category II
Short-term, temporary overvoltage	Between cable and neutral conductor up to 1200 V for max. 5s
Long-term, temporary overvoltage	Up to 500 V between cable and ground

Cable specification

Requirements for connecting cable	36
Ground cable requirements	36
Connecting cable requirements	37

Requirements for connecting cable

Electrical safety

As per applicable national regulations.

Permitted temperature range

- Observe the installation guidelines that apply in the country of installation.
- The cables must be suitable for the minimum temperatures and maximum temperatures to be expected.

Power supply cable (incl. conductor for the inner ground terminal)

- A standard installation cable is sufficient.
- Provide grounding according to applicable national codes and regulations.


Signal cable

- Current output 4 to 20 mA HART:
A shielded cable is recommended, observe the grounding concept of the facility.
- Pulse/frequency/switch output:
Standard installation cable
- Modbus RS485:
Cable type A according to EIA/TIA-485 standard is recommended
- Current output 4 to 20 mA:
Standard installation cable

Ground cable requirements

Copper wire: at least 6 mm² (0.0093 in²)

Connecting cable requirements

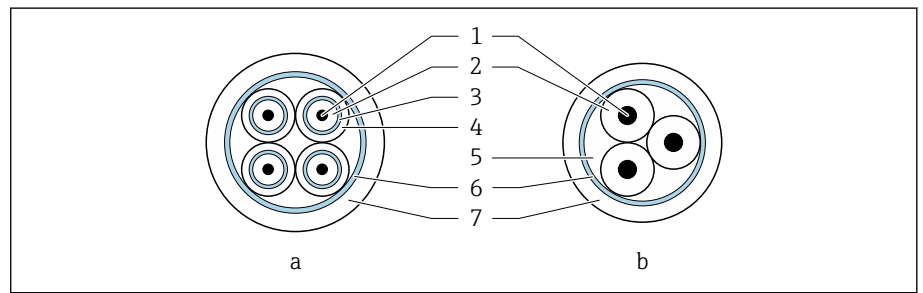

A0029151

3 Cable cross-section

- a* Electrode cable
b Coil current cable
 1 Core
 2 Core insulation
 3 Core shield
 4 Core jacket
 5 Core reinforcement
 6 Cable shield
 7 Outer jacket



Preterminated connecting cables

Two connecting cable versions can be ordered from Endress+Hauser for use with IP68 protection:

- Cable is already connected to the sensor.
- Cable is connected by the customer (incl. tools for sealing the connection compartment).



Armored connecting cable

Armored connecting cables with additional, metal reinforcing braid can be ordered from Endress+Hauser. Armored connecting cables are used:

- When laying the cable directly in the ground
- Where there is a risk of damage from rodents
- If using the device below IP68 degree of protection

Electrode cable

Design	3×0.38 mm ² (20 AWG) with common, braided copper shield (Ø ~ 9.5 mm (0.37 in)) and individual shielded cores If using the empty pipe detection (EPD) function: 4×0.38 mm ² (20 AWG) with common, braided copper shield (Ø ~ 9.5 mm (0.37 in)) and individual shielded cores
Conductor resistance	≤ 50 Ω/km (0.015 Ω/ft)
Capacitance: core/shield	≤ 420 pF/m (128 pF/ft)
Cable length	Depends on the medium conductivity: maximum 200 m (656 ft)
Cable lengths (available for order)	5 m (15 ft), 10 m (30 ft), 20 m (60 ft) or variable length: maximum 200 m (656 ft) Armored cables: variable length up to maximum 200 m (656 ft)
Operating temperature	–20 to +80 °C (–4 to +176 °F)

Coil current cable

Design	3×0.38 mm ² (20 AWG) with common, braided copper shield (Ø ~ 9.5 mm (0.37 in)) and individual shielded cores
Conductor resistance	≤ 37 Ω/km (0.011 Ω/ft)
Capacitance: core/shield	≤ 120 pF/m (37 pF/ft)
Cable length	Depends on the medium conductivity, max. 200 m (656 ft)

Cable lengths (available for order)	5 m (15 ft), 10 m (30 ft), 20 m (60 ft) or variable length up to max. 200 m (656 ft) Armored cables: variable length up to max. 200 m (656 ft)
Operating temperature	-20 to +80 °C (-4 to +176 °F)
Test voltage for cable insulation	≤ AC 1 433 V rms 50/60 Hz or ≥ DC 2 026 V

Performance characteristics

Reference operating conditions	40
Maximum measured error	40
Repeatability	40
Influence of ambient temperature	40

Reference operating conditions

- Error limits based on ISO 20456:2017
- Water, typically: +15 to +45 °C (+59 to +113 °F); 0.5 to 7 bar (73 to 101 psi)
- Data as indicated in the calibration protocol
- Accuracy based on accredited calibration rigs according to ISO 17025

i To obtain measured errors, use the *Applicator* sizing tool → *Service-specific accessory*, 131

Maximum measured error


o. r. = of reading

Error limits under reference operating conditions

Volume flow

± 0.5 % o. r. ± 1 mm/s (± 0.04 in/s)

i Fluctuations in the supply voltage do not have any effect within the specified range.

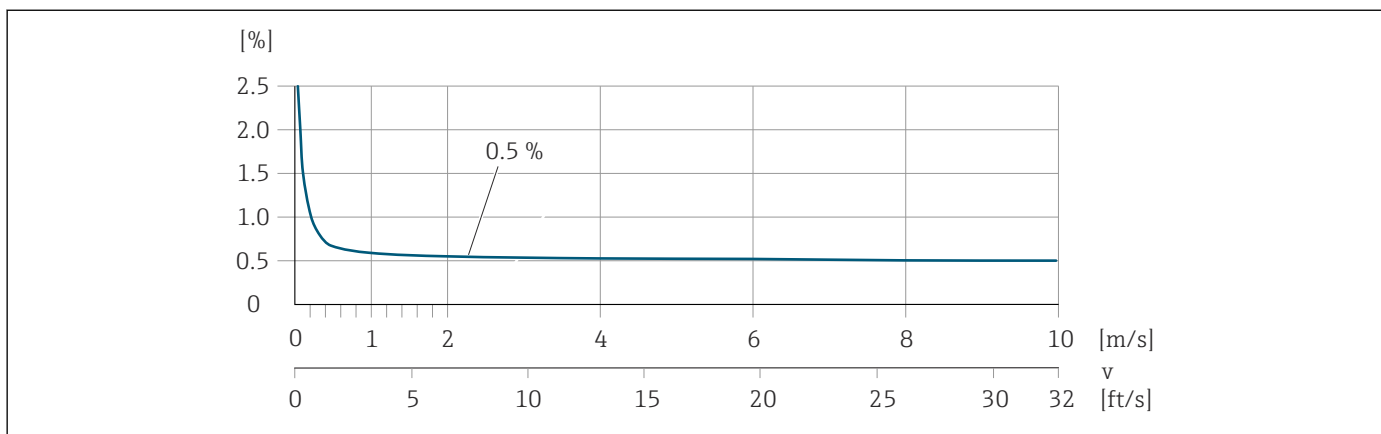

Electrical conductivity

Max. measured error not specified.

Accuracy of outputs

Current output	± 5 μ A
Pulse/frequency output	Max. ± 100 ppm o. r. (across the entire ambient temperature range)

Repeatability

Volume flow	Max. ± 0.1 % o. r. ± 0.5 mm/s (0.02 in/s)
Electrical conductivity	Max. ± 5 % o. r. (5 to 100 000 μ S/cm)

Influence of ambient temperature

Current output	Temperature coefficient max. 1 μ A/°C
Pulse/frequency output	No additional effect. Is included in the accuracy.


Installation

Installation conditions

42

Installation conditions

Flow direction

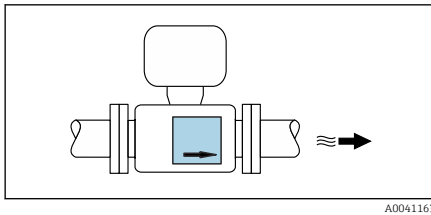


Install the device in the direction of flow.



Note the direction of arrow on the nameplate.

Installation with inlet runs and outlet runs


Installation requires inlet and outlet runs: devices with the order code for "Design", option D, E, F and G.

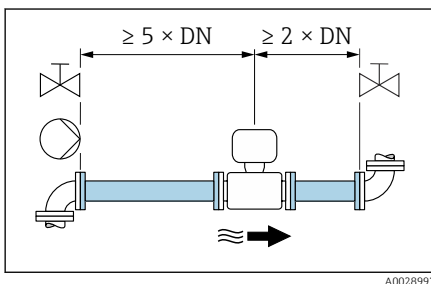

Ensure straight, undisturbed inlet and outlet runs.



To avoid negative pressure and to comply with accuracy specifications, install the sensor upstream from assemblies that produce turbulence (e.g. valves, T-sections) and downstream from pumps → *Installation near pumps*, 45.

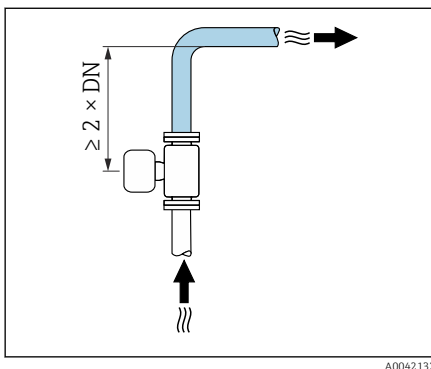

Keep a sufficient distance to the next pipe elbow.

Installation without inlet runs and outlet runs

Depending on the device design and installation location, the inlet and outlet runs can be reduced or omitted entirely.




Maximum measured error

When the device is installed with the inlet and outlet runs described, a maximum measured error of $\pm 0.5\%$ of the reading $\pm 1 \text{ mm/s}$ (0.04 in/s) can be guaranteed.


Devices and possible order options

Order code for "Design"		
Option	Description	Design
H	Lap joint flange, 0 x DN inlet/outlet runs	Full Bore ¹⁾
I	Fixed flange, 0 x DN inlet/outlet runs	
J	Fixed flange, short installed length, 0 x DN inlet/outlet runs	
K	Fixed flange, long installed length, 0 x DN inlet/outlet runs	

1) "Full Bore" stands for the full diameter of the measuring tube. There is no pressure loss with a full diameter.

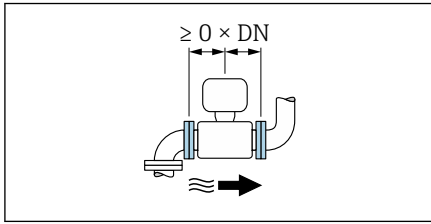

For devices with the order code for "Design", option H, I no inlet or outlet runs need to be considered.

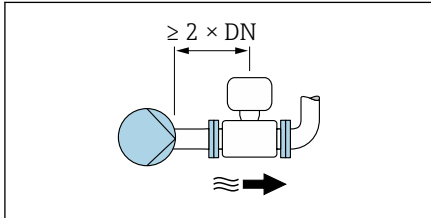


Installation downstream of pumps

Installation without inlet and outlet runs is possible: devices with the order code for "Design", option H and I.



For devices with the order code for "Design", option J and K, inlet runs of only $\geq 2 \times \text{DN}$ must be taken into consideration.

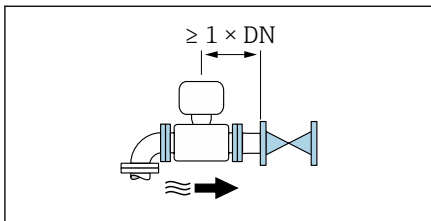


Installation upstream of valves

Installation without inlet and outlet runs is possible: devices with the order code for "Design", option H and I.



For devices with the order code for "Design", option J and K, outlet runs of only $\geq 1 \times \text{DN}$ must be taken into consideration.

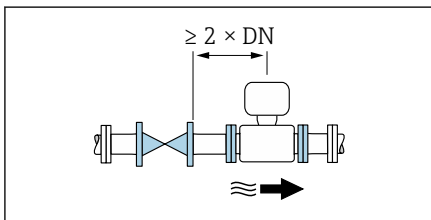


Installation downstream of valves

Installation without inlet and outlet runs is possible if the valve is 100% open during operation: devices with the order code for "Design", option H and I.




In the case of devices with the order code for "Design", option J and K, an inlet run of only $\geq 2 \times \text{DN}$ must be taken into consideration if the valve is 100% open during operation.

Orientations

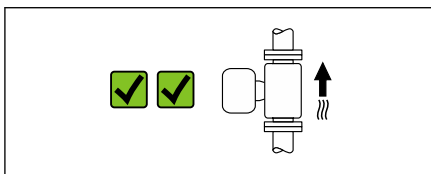

Vertical orientation, upward direction of flow


For all applications.

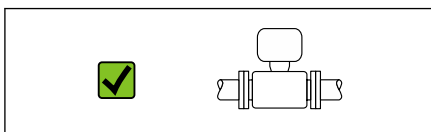

Horizontal orientation, transmitter at top

This orientation is suitable for the following applications:

- For low process temperatures in order to maintain the minimum ambient temperature for the transmitter.
- For empty pipe detection, even in the case of empty or partially filled measuring pipes.

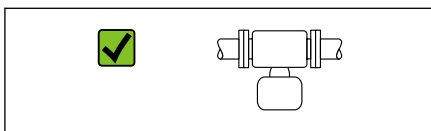


Horizontal orientation, transmitter at bottom

This orientation is suitable for the following applications:

- For high process temperatures in order to maintain the maximum ambient temperature for the transmitter.
- To prevent the electronics from overheating in the event of strong heat formation (e.g. CIP or SIP cleaning process), install the measuring device with the transmitter part pointing downwards.

This orientation is not suitable for the following applications:

If empty pipe detection is to be used.




Horizontal orientation, transmitter at side

This orientation is not suitable

Vertical


Optimum for self-emptying pipe systems and for use in conjunction with empty pipe detection.



A0015591

Horizontal

- Ideally, the measuring electrode plane should be horizontal. This prevents brief insulation of the measuring electrodes by entrained air bubbles.
- Empty pipe detection only works if the transmitter housing is pointing upwards as otherwise there is no guarantee that the empty pipe detection function will actually respond to a partially filled or empty measuring tube.




A0029344


- 1 EPD electrode for empty pipe detection
- 2 Measuring electrodes for signal detection
- 3 Reference electrode for potential equalization

Mounting locations

- Do not install the device at the highest point of the pipe.
- Do not install the device upstream from a free pipe outlet in a down pipe.

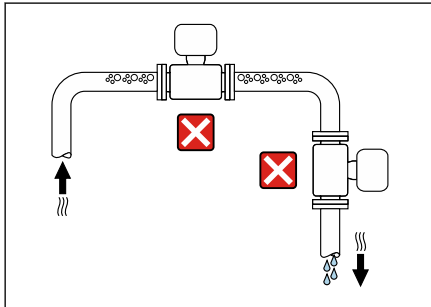


A0042131

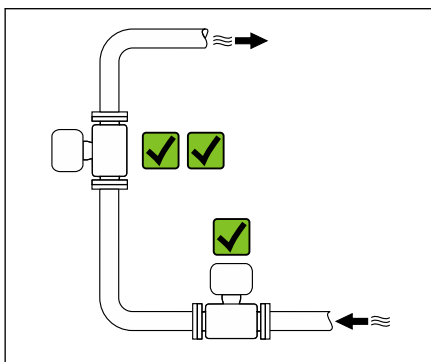

A0042317


The device should ideally be installed in an ascending pipe.

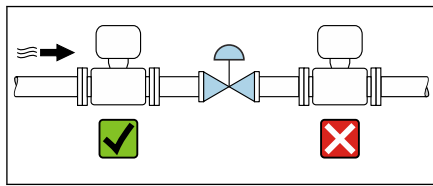

A0041091

Installation near control valves

Install the device in the direction of flow upstream from the control valve.

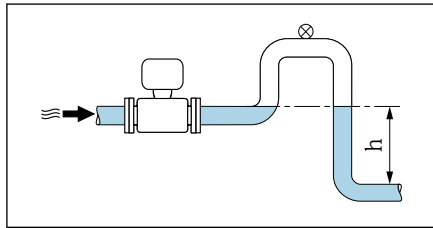

A0041089

Installation upstream from a down pipe


NOTICE

Negative pressure in the measuring pipe can damage the liner!

- ▶ If installing upstream from down pipes with a length $h \geq 5 \text{ m}$ (16.4 ft): install a siphon with a vent valve downstream from the device.



This arrangement prevents the flow of liquid stopping in the pipe and air entrainment.

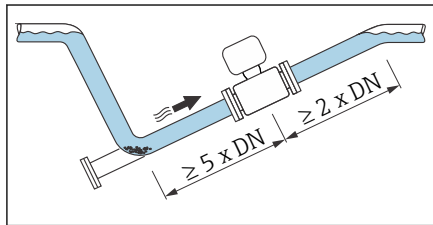


A0041088

Installation with partially filled pipes

- Partially filled pipes with a gradient require a drain-type configuration.
- The installation of a cleaning valve is recommended.



For devices with the order code for "Design", option H, I, J or K no inlet or outlet runs need to be considered.

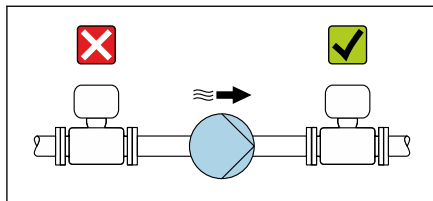

A0041083

Installation near pumps


NOTICE

Negative pressure in the measuring pipe can damage the liner!

- ▶ Install the device in the direction of flow downstream from the pump.
- ▶ Install pulsation dampers if reciprocating, diaphragm or peristaltic pumps are used.



- Information on the liner's resistance to partial vacuum → *Pressure tightness*, 59
- Information on the measuring system's resistance to vibration and shock → *Vibration-resistance and shock-resistance*, 51

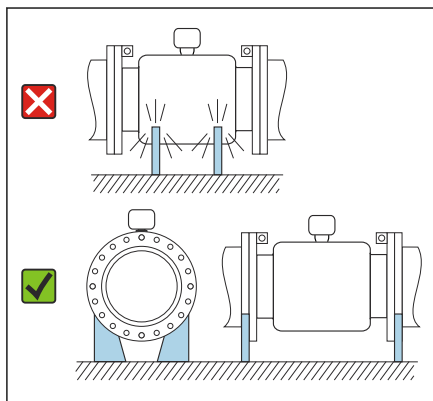

A0041087

Installation of very heavy devices

Support is required with nominal diameters of $\text{DN} \geq 350$ (14") and higher.

NOTICE

Damage to the device!

If incorrect support is provided, the sensor housing could buckle and the internal magnetic coils could be damaged.

- ▶ Only provide supports at the pipe flanges.


Pipe vibrations

A remote version is recommended in the event of strong pipe vibrations.

NOTICE

Pipe vibrations can damage the device!

- ▶ Do not expose the device to strong vibrations.
- ▶ Support the pipe and fix it in place.
- ▶ Support the device and fix it in place.
- ▶ Mount the sensor and transmitter separately.

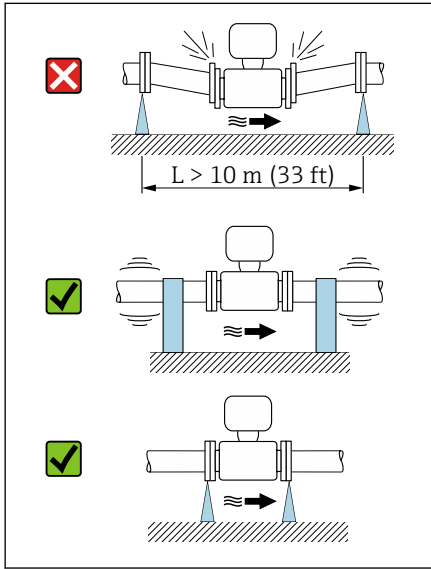


A0041092

Adapters

Suitable adapters (double-flange reducers) can be used to install the sensor in larger-diameter pipes. The resulting higher rate of flow improves measuring accuracy with very slow-moving media.

i The nomogram shown here can be used to calculate the pressure loss caused by reducers and expanders. It only applies to liquids with a viscosity similar to that of water.

1. Calculate the ratio of the diameters d/D .
2. Determine the flow velocity after the reduction.
3. From the chart, determine the pressure loss as a function of the flow velocity v and the d/D ratio.

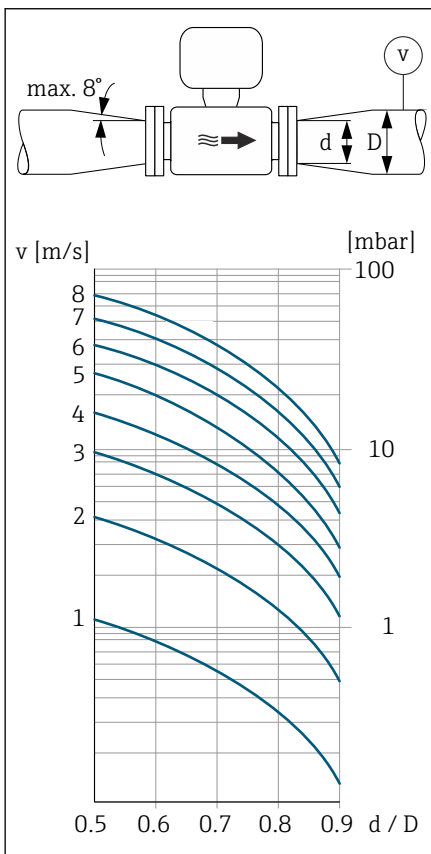

A0041086


Seals

Note the following when installing seals:

- For liner with polyurethane: no seal is required.
- For "PTFE" liner: no seal is required.
- For liner with hard rubber: seal is **always** required.
- For DIN flanges: only install seals according to DIN EN 1514-1.

Thermal insulation

The sensor and pipe must be insulated in the event of very hot media. The insulation helps to slow energy loss and prevent injuries from accidental contact with hot pipes.

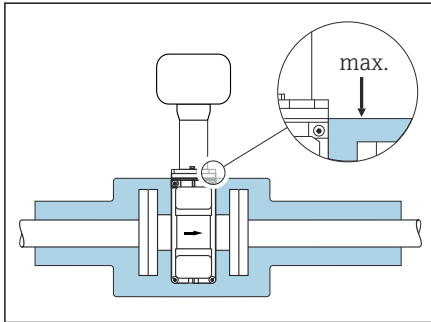

A0041093


NOTICE

If the meter electronics overheat this can damage the device!

- ▶ Keep the housing support completely free (heat dissipation).
- ▶ Provide insulation but make sure it does not go beyond the upper edge of the two sensor half-shells.


Magnetism and static electricity

Do not install the device near magnetic fields, e.g. motors, pumps, transformers.

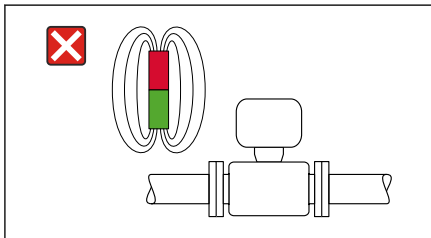

A0042152

Outdoor use

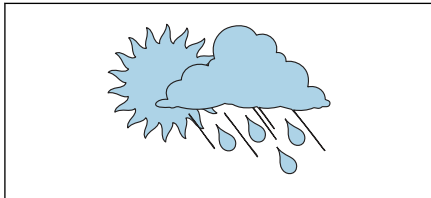

A0023989

- Avoid exposure to direct sunlight.
- Install in a location protected from sunlight.
- Avoid direct exposure to weather conditions.
- Use a weather protection cover → *Transmitter*, 130.

Immersion in water



Only the remote version with IP68, type 6P, is suitable for immersion in water.

NOTICE

If the maximum water depth and operating duration are exceeded, this will damage the device!

- ▶ Observe the maximum water depth and operating duration.

Order code for "Sensor option", options CB, CC

Use of device under water at a maximum water depth of:

- 3 m (10 ft): permanent use
- 10 m (30 ft): max. 48 hours


Order code for "Sensor option", option CQ "Temporarily water-proof"

Temporary use of the device under non-corrosive water at a maximum water depth of:

- 3 m (10 ft): max. 168 hours

Order code for "Sensor option", options CD, CE

- For the operation of the device under water and in saline water
- Operating duration at a maximum depth of:
 - 3 m (10 ft): permanent use
 - 10 m (30 ft): maximum 48 hours

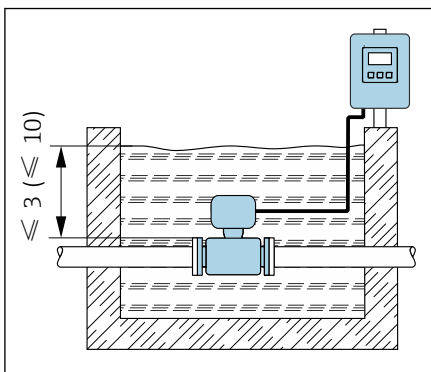

A0042412


Use in buried applications

Only the remote version with IP68 is suitable for use in buried applications.

Order code for "Sensor option", options CD, CE

The device can be used in buried applications without the need to implement additional precautionary measures on the device.

Installation is performed according to regional installation regulations.

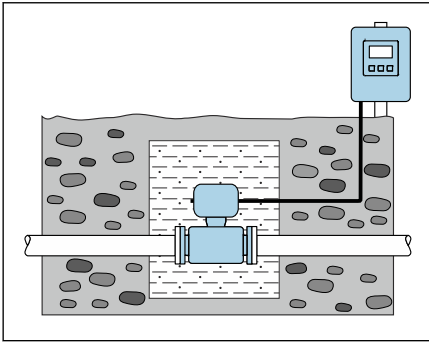

A0042646

Environment

Ambient temperature range	50
Storage temperature	50
Relative humidity	50
Operating height	50
Atmosphere	50
Degree of protection	50
Vibration-resistance and shock-resistance	51
Electromagnetic compatibility (EMC)	51

Ambient temperature range

Transmitter	–40 to +60 °C (–40 to +140 °F)
Local display	–20 to +60 °C (–4 to +140 °F) The readability of the display may be impaired at temperatures outside the temperature range.
Sensor	■ Process connection, carbon steel: –10 to +60 °C (+14 to +140 °F) ■ Process connection, stainless steel: –40 to +60 °C (–40 to +140 °F)
Liner	Do not exceed or fall below the permitted temperature range of the liner → <i>Medium temperature range</i> , 54.
	 Dependency of ambient temperature on medium temperature → <i>Medium temperature range</i> , 54

Storage temperature

The storage temperature corresponds to the ambient temperature range of the transmitter and sensor.

Relative humidity

The device is suitable for use in outdoor and indoor areas with a relative humidity of 5 to 95%.

Operating height

According to EN 61010-1

- Without overvoltage protection: ≤ 2 000 m
- With overvoltage protection: > 2 000 m

Atmosphere

According to IEC 60529: If a plastic housing is permanently exposed to certain steam and air mixtures, this can damage the housing.

 More Informationen: Endress+Hauser sales organizations.

Degree of protection

Transmitter	■ IP66/67, Type 4X enclosure, suitable for pollution degree 4 ■ Open housing: IP20, Type 1 enclosure, suitable for pollution degree 2	
Sensor	IP66/67, Type 4X enclosure, suitable for pollution degree 4	
Optional sensor		
Order code for "Sensor option", option CB, CC	IP68, Type 6P enclosure Fully welded, with protective coating as per EN ISO 12944 C5-M and EN 60529	Use of device under water at a maximum water depth of: ■ 3 m (10 ft): permanent use ■ 10 m (30 ft): max. 48 hours
Order code for "Sensor option", option CD, CE	IP68, type 6P enclosure Fully welded, with protective coating as per EN ISO 12944 Im2/Im3 and EN 60529	Use of the device in buried applications, under water and in saline water at a maximum water depth of: ■ 3 m (10 ft): permanent use ■ 10 m (30 ft): max. 48 hours ■ Use of device under water at a maximum water depth of: 10 m (30 ft): max. 48 hours ■ Use of device in buried applications

Order code for "Sensor option", option CQ	IP68, type 6P, temporarily waterproof	Temporary use of the device under non-corrosive water at a maximum water depth of: 3 m (10 ft): max. 168 hours
Order code for "Sensor option", option C3	IP66/67, type 4X enclosure Fully welded, with protective coating as per EN ISO 12944 C5-M	For operation in corrosive environment

Vibration-resistance and shock-resistance

Compact version

Vibration, sinusoidal ■ Following IEC 60068-2-6 ■ 20 cycles per axis	2 to 8.4 Hz 8.4 to 2 000 Hz	3.5 mm peak 1 g peak
Vibration, broad-band random ■ Following IEC 60068-2-64 ■ 120 min per axis	10 to 200 Hz 200 to 2 000 Hz	0.003 g ² /Hz 0.001 g ² /Hz (1.54 g rms)
Shocks, half-sine ■ Following IEC 60068-2-27 ■ 3 positive and 3 negative shocks	6 ms 30 g	

Shock

Due to rough handling according to IEC 60068-2-31.

Remote version (sensor)

Vibration, sinusoidal ■ Following IEC 60068-2-6 ■ 20 cycles per axis	2 to 8.4 Hz 8.4 to 2 000 Hz	7.5 mm peak 2 g peak
Vibration, broad-band random ■ Following IEC 60068-2-6 ■ 120 min per axis	10 to 200 Hz 200 to 2 000 Hz	0.01 g ² /Hz 0.003 g ² /Hz (2.7 g rms)
Shocks, half-sine ■ Following IEC 60068-2-6 ■ 3 positive and 3 negative shocks	6 ms 50 g	

Shock

Due to rough handling according to IEC 60068-2-31.

Electromagnetic compatibility (EMC)

As per IEC/EN 61326 and NAMUR Recommendation NE 21.



For more information: Declaration of Conformity

Process

Medium temperature range	54
Conductivity	54
Flow limit	54
Pressure-temperature ratings	56
Pressure tightness	59
Pressure loss	59

Medium temperature range

The medium temperature range depends on the liner.

Hard rubber	0 to +80 °C (+32 to +176 °F)
Polyurethane	-20 to +50 °C (-4 to +122 °F)
PTFE	■ Process connection, carbon steel: -10 to +90 °C (+14 to +194 °F) ■ Process connection, stainless steel: -20 to +90 °C (-4 to +194 °F)

Conductivity


The minimum conductivity is:

- 5 $\mu\text{S}/\text{cm}$ for liquids in general
- 20 $\mu\text{S}/\text{cm}$ for demineralized water

The following basic conditions must be observed for $< 20 \mu\text{S}/\text{cm}$:

- Order code 013 for "Functionality", option D "Extended transmitter" and higher output signal damping is recommended for values under $20 \mu\text{S}/\text{cm}$.
- Observe the maximum permitted cable length L_{max} . This length is determined by the conductivity of the medium.
- With order code 013 "Functionality", option A "Standard transmitter" and empty pipe detection (EPD) switched on, the minimum conductivity is $20 \mu\text{S}/\text{cm}$.
- With order code 013 "Functionality", option A "Standard transmitter" - remote version, empty pipe detection may not be activated if $L_{\text{max}} > 20 \text{ m}$.

i Note that in the case of the remote version, the minimum conductivity depends on the cable length.

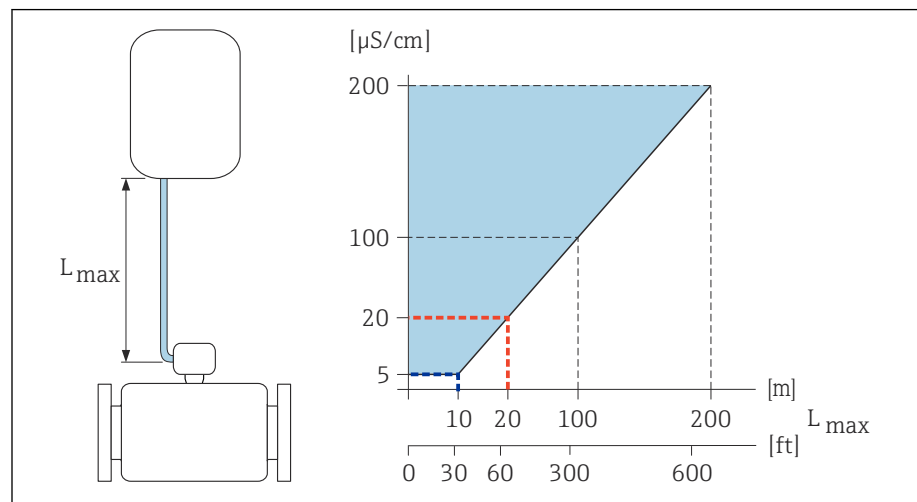

4 Permitted length of connecting cable

Colored area = permitted range

L_{max} = length of connecting cable in [m] ([ft])

$[\mu\text{S}/\text{cm}]$ = medium conductivity

Red line = order code 013 "Functionality", option A "Standard transmitter"

Blue line = order code 013 "Functionality", option D "Extended transmitter"

Flow limit

Pipe diameter and flow rate determine the nominal diameter of the sensor.

i The flow velocity is increased by reducing the sensor nominal diameter.

2 to 3 m/s (6.56 to 9.84 ft/s)	Optimum flow velocity
$v < 2$ m/s (6.56 ft/s)	For abrasive media, e.g. potter's clay, lime milk, ore slurry
$v > 2$ m/s (6.56 ft/s)	For media producing buildup, e.g. wastewater sludge


Pressure-temperature ratings

Maximum permitted medium pressure as a function of the medium temperature

The data relate to all pressure bearing parts of the device.

Fixed flange according to EN 1092-1


Stainless steel (−20 °C (−4 °F))
Carbon steel (−10 °C (14 °F))

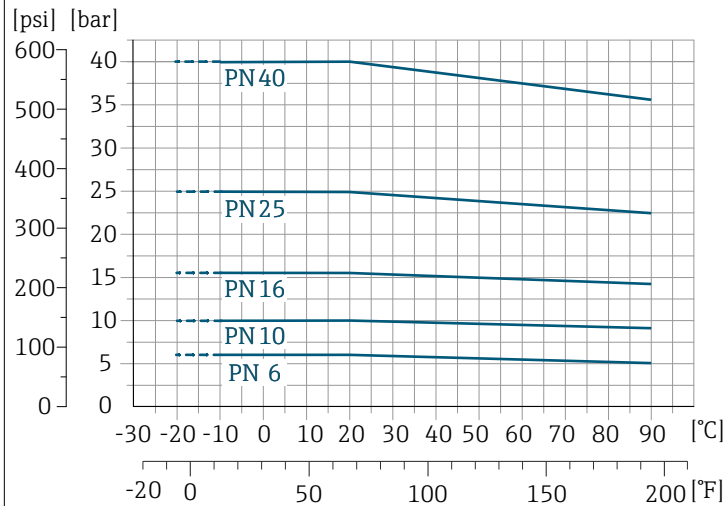

A0038122-EN


Fixed flange according to ASME B16.5

Stainless steel

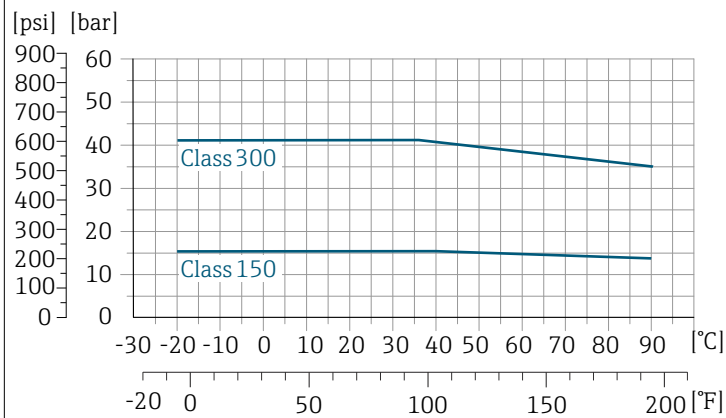

A0038123-EN


Carbon steel

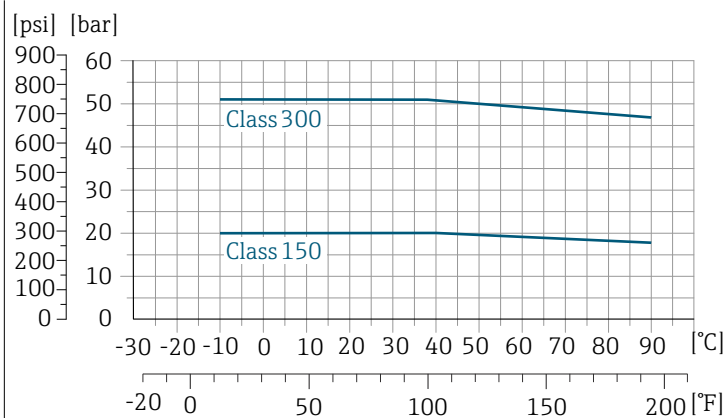

A0038121-EN

Fixed flange according to JIS B2220


Stainless steel (-20 °C (-4 °F))
Carbon steel (-10 °C (14 °F))

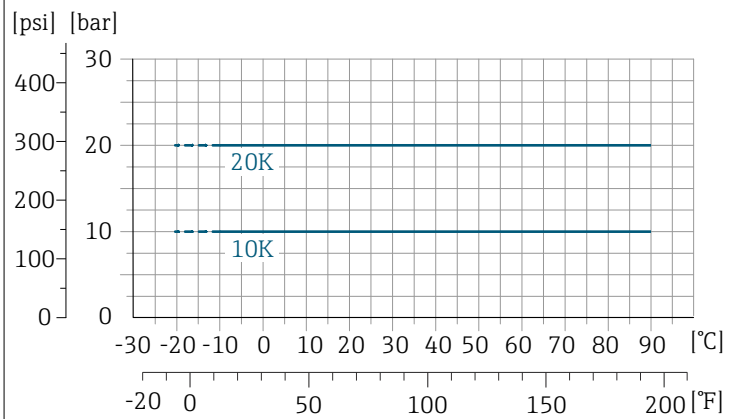

A0038124-EN

Fixed flange according to AWWA C207


Carbon steel

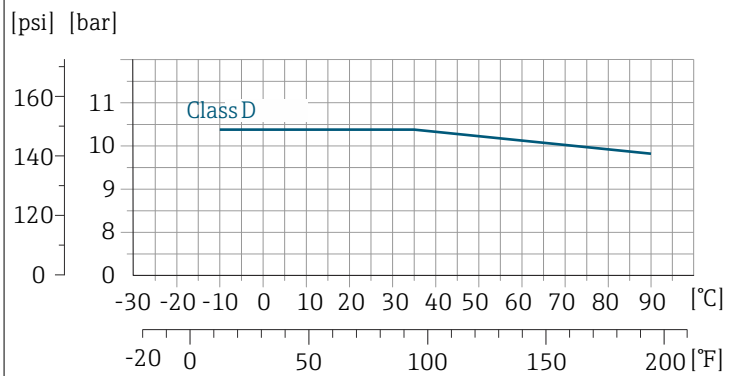

A0038126-EN

Fixed flange according to AS 2129


Carbon steel

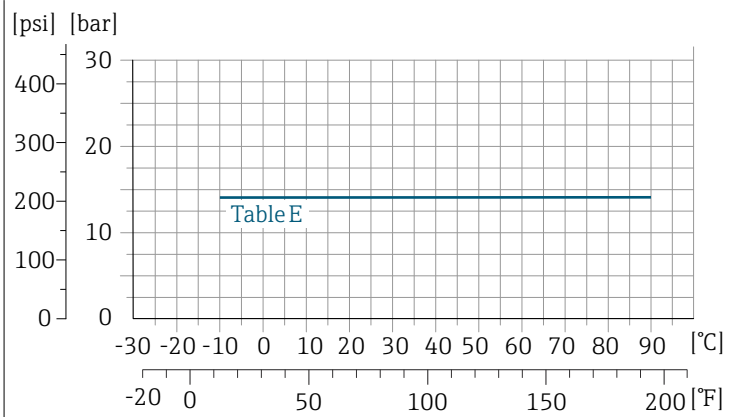

A0038127-EN

Fixed flange according to AS 4087

Carbon steel

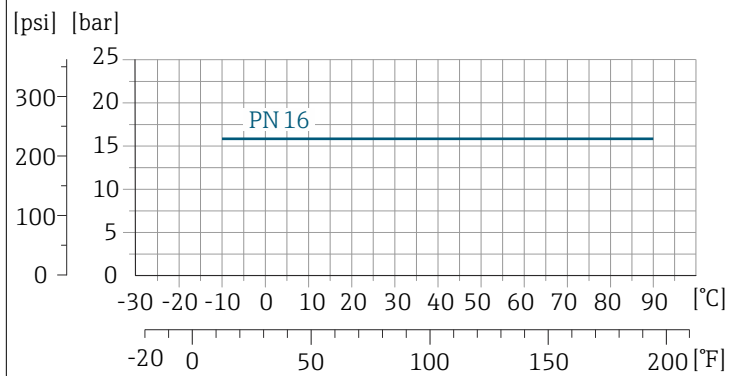


A0038128-EN

Lap joint flange/lap joint flange, stamped plate according to EN 1092-1 and ASME B16.5

Stainless steel (-20 °C (-4 °F))

Carbon steel (-10 °C (14 °F))

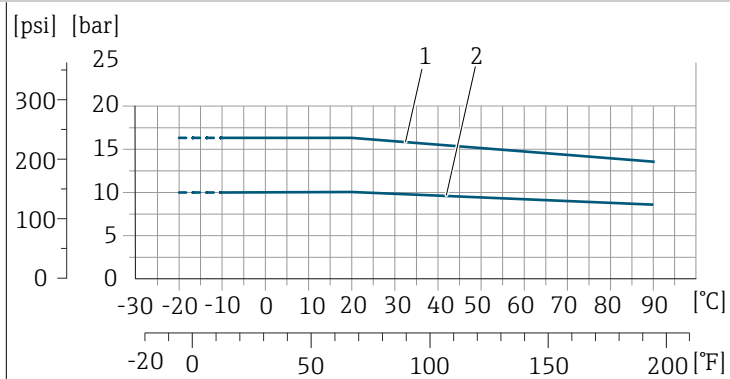

A0038129-EN

1 Lap joint flange PN16/Class150

2 Lap joint flange, stamped plate PN10, lap joint flange PN10

Pressure tightness

Limit values for the absolute pressure depending on the liner and medium temperature

PTFE	Nominal diameter		Absolute pressure in [mbar] ([psi])	
	[mm]	[in]	+25 °C (+77 °F)	+90 °C (+194 °F)
	25	1	0 (0)	0 (0)
	40	2	0 (0)	0 (0)
	50	2	0 (0)	0 (0)
	65	2 ½	0 (0)	40 (0.58)
	80	3	0 (0)	40 (0.58)
	100	4	0 (0)	135 (2.0)
	125	5	135 (2.0)	240 (3.5)
	150	6	135 (2.0)	240 (3.5)
	200	8	200 (2.9)	290 (4.2)
	250	10	330 (4.8)	400 (5.8)
	300	12	400 (5.8)	500 (7.3)

Hard rubber	+25 °C (+77 °F)	+50 °C (+122 °F)	+80 °C (+176 °F)
	0 (0)	0 (0)	0 (0)

Polyurethane	+25 °C (+77 °F)	+50 °C (+122 °F)
	0 (0)	0 (0)

Pressure loss

- No pressure loss: transmitter installed in a pipe with the same nominal diameter.
- Pressure loss information when adapters are used → *Adapters*, 46

Mechanical construction

Weight	62
Measuring pipe specification	66
Materials	67
Fitted electrodes	68
Process connections	68
Surface roughness	68

Weight

All values refer to devices with flanges with a standard pressure rating.
Weight data are guideline values. The weight may be lower than indicated depending on the pressure rating and design.

Transmitter remote version

- Polycarbonate: 1.4 kg (3.1 lbs)
- Aluminum: 2.4 kg (5.3 lbs)

Sensor remote version

Aluminum sensor connection housing: see the information in the following table.

Weight in SI units

Order code for "Design", options D, E, H, I	Nominal diameter		EN (DIN), AS, JIS		ASME (Class 150)
	[mm]	[in]	Pressure rating	[kg]	[kg]
	25	1	PN 40	10	5
	32	–	PN 40	11	–
	40	1 ½	PN 40	12	7
	50	2	PN 40	13	9
	65	–	PN 16	13	–
	80	3	PN 16	15	14
	100	4	PN 16	18	19
	125	–	PN 16	25	–
	150	6	PN 16	31	33
	200	8	PN 10	52	52
	250	10	PN 10	81	90
	300	12	PN 10	95	129
	350	14	PN 6	106	172
	375	15	PN 6	121	–
	400	16	PN 6	121	203

Order code for "Design", options G, K	Nominal diameter		EN (DIN) (PN 6)	ASME (Class 150), AWWA (Class D)
	[mm]	[in]	[kg]	[kg]
	450	18	161	255
	500	20	156	285
	600	24	208	405
	700	28	304	400
	–	30	–	460
	800	32	357	550
	900	36	485	800
	1000	40	589	900
	–	42	–	1 100
	1200	48	850	1 400
	–	54	850	2 200
	1400	–	1 300	–
	–	60	–	2 700

Order code for "Design", options G, K	Nominal diameter		EN (DIN) (PN 6)	ASME (Class 150), AWWA (Class D)
	[mm]	[in]	[kg]	[kg]
	1600	–	1 845	–
	–	66	–	3 700
	1800	72	2 357	4 100
	–	78	2 929	4 600
	2000	–	2 929	–

Order code for "Design", options F, J	Nominal diameter		EN (DIN) (PN16)	AS (PN 16)	ASME (Class 150), AWWA (Class D)
	[mm]	[in]	[kg]	[kg]	[kg]
	450	18	142	138	191
	500	20	182	186	228
	600	24	227	266	302
	700	28	291	369	266
	–	30	–	447	318
	800	32	353	524	383
	900	36	444	704	470
	1000	40	566	785	587
	–	42	–	–	670
	1200	48	843	1 229	901
	–	54	–	–	1 273
	1400	–	1 204	–	–
	–	60	–	–	1 594
	1600	–	1 845	–	–
	–	66	–	–	2 131
	1800	72	2 357	–	2 568
	–	78	2 929	–	3 113
	2000	–	2 929	–	3 113
	–	84	–	–	3 755
	2200	–	3 422	–	–
	–	90	–	–	4 797
	2400	–	4 094	–	–

Weight in US units

All values refer to devices with flanges with a standard pressure rating.
Weight data are guideline values. The weight may be lower than indicated depending on the pressure rating and design.

Transmitter remote version

- Polycarbonate: 3.1 lb
- Aluminum: 5.3 lb

Sensor remote version

Aluminum sensor connection housing: see the information in the following table.

Order code for "Design", options D, E, H, I	Nominal diameter		ASME (Class 150)
	[mm]	[in]	[lb]
	25	1	11
	32	–	–
	40	1 ½	15
	50	2	20
	65	–	–
	80	3	31
	100	4	42
	125	–	–
	150	6	73
	200	8	115
	250	10	198
	300	12	284
	350	14	379
	375	15	–
	400	16	448

Order code for "Design", options F, J	Nominal diameter		ASME (Class 150), AWWA (Class D)
	[mm]	[in]	[lb]
	450	18	421
	500	20	503
	600	24	666
	700	28	587
	–	30	701
	800	32	845
	900	36	1036
	1000	40	1294
	–	42	1477
	1200	48	1987
	–	54	2807
	1400	–	–
	–	60	3 515
	1600	–	–
	–	66	4 699
	1800	72	5 662

Order code for "Design", options F, J	Nominal diameter		ASME (Class 150), AWWA (Class D)
	[mm]	[in]	[lb]
	–	78	6 864
	2000	–	6 864
	–	84	8 280
	2200	–	–
	–	90	10 577
	2400	–	–

Order code for "Design", options G, K	Nominal diameter		ASME (Class 150), AWWA (Class D)
	[mm]	[in]	[lb]
	450	18	562
	500	20	628
	600	24	893
	700	28	882
	–	30	1 014
	800	32	1 213
	900	36	1 764
	1000	40	1 984
	–	42	2 426
	1200	48	3 087
	–	54	4 851
	1400	–	–
	–	60	5 954
	1600	–	–
	–	66	8 158
	1800	72	9 040
	–	78	10 143
	2000	–	–

Measuring pipe specification

Nominal diameter		Rating				Measuring pipe internal diameter					
[mm]	[in]	EN (DIN)	ASME AWWA	AS 2129 AS 4087	JIS	Hard rubber		Polyurethane		PTFE	
						[mm]	[in]	[mm]	[in]	[mm]	[in]
25	1	PN 40	Class 150	–	20K	–	–	24	0.94	25	0.98
32	–	PN 40	–	–	20K	–	–	32	1.26	34	1.34
40	1 ½	PN 40	Class 150	–	20K	–	–	38	1.50	40	1.57
50	2	PN 40	Class 150	Table E, PN 16	10K	50	1.97	50	1.97	52	2.05
65	–	PN 16	–	–	10K	66	2.60	66	2.60	68	2.68
80	3	PN 16	Class 150	Table E, PN 16	10K	79	3.11	79	3.11	80	3.15
100	4	PN 16	Class 150	Table E, PN 16	10K	102	4.02	102	4.02	104	4.09
125	–	PN 16	–	–	10K	127	5.00	127	5.00	130	5.12
150	6	PN 16	Class 150	Table E, PN 16	10K	156	6.14	156	6.14	156	6.14
200	8	PN 10	Class 150	Table E, PN 16	10K	204	8.03	204	8.03	202	7.95
250	10	PN 10	Class 150	Table E, PN 16	10K	258	10.2	258	10.2	256	10.08
300	12	PN 10	Class 150	Table E, PN 16	10K	309	12.2	309	12.2	306	12.05
350	14	PN 6	Class 150	Table E, PN 16	10K	337	13.3	342	13.5	–	–
375	15	–	–	PN 16	10K	389	15.3	–	–	–	–
400	16	PN 6	Class 150	Table E, PN 16	10K	387	15.2	392	15.4	–	–
450	18	PN 6	Class 150	–	10K	436	17.1	437	17.2	–	–
500	20	PN 6	Class 150	Table E, PN 16	10K	487	19.1	492	19.4	–	–
600	24	PN 6	Class 150	Table E, PN 16	10K	589	23.0	594	23.4	–	–
700	28	PN 6	Class D	Table E, PN 16	10K	688	27.1	692	27.2	–	–
750	30	–	Class D	Table E, PN 16	10K	737	29.1	742	29.2	–	–
800	32	PN 6	Class D	Table E, PN 16	–	788	31.0	794	31.3	–	–
900	36	PN 6	Class D	Table E, PN 16	–	889	35.0	891	35.1	–	–
1000	40	PN 6	Class D	Table E, PN 16	–	991	39.0	994	39.1	–	–
–	42	–	Class D	–	–	1043	41.1	1043	41.1	–	–
1200	48	PN 6	Class D	Table E, PN 16	–	1191	46.9	1197	47.1	–	–
–	54	–	Class D	–	–	1339	52.7	–	–	–	–
1400	–	PN 6	–	–	–	1402	55.2	–	–	–	–
–	60	–	Class D	–	–	1492	58.7	–	–	–	–
1600	–	PN 6	–	–	–	1600	63.0	–	–	–	–
–	66	–	Class D	–	–	1638	64.5	–	–	–	–
1800	72	PN 6	–	–	–	1786	70.3	–	–	–	–
–	78	–	Class D	–	–	1989	78.3	–	–	–	–
2000	–	PN 6	–	–	–	1989	78.3	–	–	–	–
–	84	–	Class D	–	–	2099	84.0	–	–	–	–
2200	–	PN 6	–	–	–	2194	87.8	–	–	–	–
–	90	–	Class D	–	–	2246	89.8	–	–	–	–
2400	–	PN 6	–	–	–	2391	94.1	–	–	–	–

Materials

Transmitter housing

Order code for "Housing"	■ Option A: aluminum, AlSi10Mg, coated ■ Option M: polycarbonate
Window material	■ Order code for "Housing" option A: glass ■ Order code for "Housing" option M: polycarbonate

Sensor connection housing

- Aluminum, AlSi10Mg, coated
- Polycarbonate (in conjunction with order code for "Sensor option", options CB, CC, CD, CE, CF, CQ, C3)

Cable glands and entries

Cable gland M20×1.5	Plastic
Adapter for cable entry with female thread G ½" or NPT ½"	Nickel-plated brass

Connecting cable for remote version

- Electrode cable and coil current cable:
- PVC cable with copper shield
 - Reinforced cable: PVC cable with copper shield and additional steel wire braided jacket

Sensor housing

DN 25 to 300 (1 to 12")	■ Aluminum half-shell housing: aluminum, AlSi10Mg, coated ■ Fully welded carbon steel housing with protective varnish
DN 350 to 3 000 (14 to 120")	Fully welded carbon steel housing with protective varnish

Measuring tubes

DN 25 to 600 (1 to 24")	Stainless steel: 1.4301, 1.4306, 304, 304L
DN 700 to 3 000 (28 to 120")	Stainless steel: 1.4301, 304

Liner

DN 25 to 300 (1 to 12")	PTFE
DN 25 to 1200 (1 to 48")	Polyurethane
DN 50 to 3 000 (2 to 120")	Hard rubber

Electrodes

- Stainless steel: 1.4435 (316L)
- Alloy C22, 2.4602 (UNS N06022)

Seals

As per DIN EN 1514-1, Form IBC

Process connections

EN 1092-1 (DIN 2501)	 For flanges made of carbon steel: ▪ DN ≤ 300 (12"): with Al/Zn protective coating or protective varnish ▪ DN ≥ 350 (14"): protective varnish  All carbon steel lap joint flanges are supplied with a hot-dip galvanized finish.
	Fixed flange ▪ Carbon steel: ▪ DN ≤ 300: S235JRG2, S235JR+N, P245GH, A105, E250C ▪ DN 350 to 3 000: P245GH, S235JRG2, A105, E250C ▪ DN 350 to 600: P245GH, S235JRG2, A105, E250C ▪ Stainless steel: ▪ DN ≤ 300: 1.4404, 1.4571, F316L ▪ DN 350 to 600: 1.4571, F316L, 1.4404 ▪ DN 700 to 1 000: 1.4404, F316L
	Lap joint flange ▪ Carbon steel DN ≤ 300: S235JRG2, A105, E250C ▪ Stainless steel DN ≤ 300: 1.4306, 1.4404, 1.4571, F316L
	Lap joint flange, stamped plate ▪ Carbon steel DN ≤ 300: S235JRG2 similar to S235JR+AR or 1.0038 ▪ Stainless steel DN ≤ 300: 1.4301 similar to 304
	▪ Carbon steel: A105 ▪ Stainless steel: F316L
ASME B16.5	
JIS B2220	▪ Carbon steel: A105, A350 LF2 ▪ Stainless steel: F316L
AWWA C207	Carbon steel: A105, P265GH, A181 Class 70, E250C, S275JR
AS 2129	Carbon steel: A105, E250C, P235GH, P265GH, S235JRG2
AS 4087	Carbon steel: A105, P265GH, S275JR

Accessories

Protective cover	Stainless steel, 1.4404 (316L)
Pipe mounting set	Stainless steel 1.4301 (304)
Wall mounting kit	Stainless steel 1.4301 (304)
Grounding rings	15 to 1 200 mm (½ to 48 in) ▪ Stainless steel, 1.4435 (316L) ▪ Alloy C22, 2.4602 (UNS N06022)

Fitted electrodes

Standard electrodes:

- Measuring electrodes
- Reference electrodes
- Empty pipe detection electrodes

Process connections

- EN 1092-1 (DIN 2501)
- ASME B16.5
- JIS B2220
- AS 2129 Table E
- AS 4087 PN 16
- AWWA C207 Class D

Surface roughness

All data relate to parts in contact with medium.

Electrodes with 1.4435 (316L); Alloy C22, 2.4602 (UNS N06022); tantalum:
< 0.5 µm (19.7 µin)

Dimensions in SI units


Compact version	72
DN 25 to 300 (1 to 12")	72
DN 350 to 900 (14 to 36")	74
DN 1000 to 3000 (40 to 120")	76
Remote version	78
Transmitter remote version	78
Sensor connection housing	78
DN 25 to 300 (1 to 12") aluminum half-shell housing	79
DN 25 to 300 (1 to 12") fully welded housing	80
DN 350 to 900 (14 to 36")	81
DN 1000 to 3000 (40 to 120")	82
Fixed flange	83
Flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 10	83
Flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 16	84
Flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 25	85
Flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 40	86
Flange according to ASME B16.5, Class 150	87
Flange according to ASME B16.5, Class 300	88
Flange according to JIS B2220, 10K	89
Flange according to JIS B2220, 20K	90
Flange according to AWWA, Class D	91
Flange according to AS 2129, Tab. E	92
Flange according to AS 4087, PN 16	93
Lap joint flange	94
Lap joint flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 10	94
Lap joint flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 16	95
Lap joint flange according to ASME B16.5, Class 150	96
Lap joint flange, stamped plate	97
Lap joint flange, stamped plate in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 10	97
Accessories	98
Protective cover	98
Ground disks for flanges	98

Compact version

DN 25 to 300 (1 to 12")

Order code for "Housing", option A "Compact, aluminum, coated"

Sensor with aluminum half-shell housing

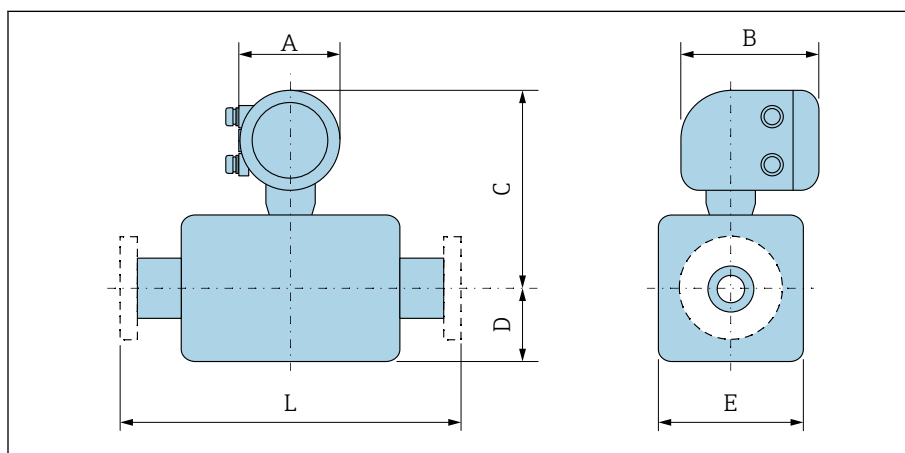

A0042708

DN		A ¹⁾ [mm]	B [mm]	Order code for "Design" Options D, E, H, I			L ³⁾ [mm]
[mm]	[in]			C ²⁾ [mm]	D ²⁾ [mm]	E ²⁾ [mm]	
25	1	139	178	258	84	120	200
32	–	139	178	258	84	120	200
40	1 ½	139	178	258	84	120	200
50	2	139	178	258	84	120	200
65	–	139	178	283	109	180	200
80	3	139	178	283	109	180	200
100	4	139	178	283	109	180	250
125	–	139	178	323	150	260	250
150	6	139	178	323	150	260	300
200	8	139	178	348	180	324	350
250	10	139	178	373	205	400	450
300	12	139	178	398	230	460	500


1) Depending on the cable entry used: values up to + 30 mm

2) Reference values: depending on the pressure rating, design and order option

3) Total installed length is independent of the process connections. Installed length according to DVGW (German Technical and Scientific Association for Gas and Water).

Order code for "Housing", option M "Compact, polycarbonate"

Sensor with aluminum half-shell housing

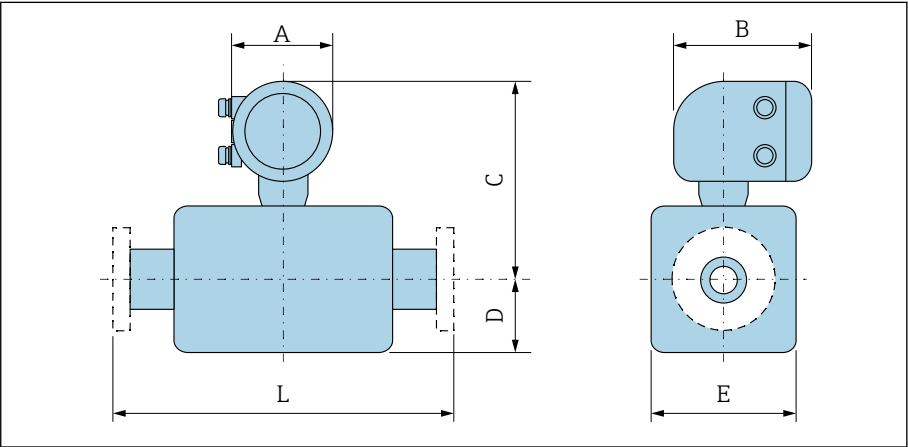


A0042708

DN		A ¹⁾	B	Order code for "Design"			L ³⁾
				Options D, E, H, I			
[mm]	[in]			[mm]	[mm]	[mm]	
25	1	132	172	255	84	120	200
32	–	132	172	255	84	120	200
40	1 ½	132	172	255	84	120	200
50	2	132	172	255	84	120	200
65	–	132	172	280	109	180	200
80	3	132	172	280	109	180	200
100	4	132	172	280	109	180	250
125	–	132	172	320	150	260	250
150	6	132	172	320	150	260	300
200	8	132	172	345	180	324	350
250	10	132	172	370	205	400	450
300	12	132	172	395	230	460	500

- 1) Depending on the cable entry used: values up to + 30 mm
- 2) Reference values: depending on the pressure rating, design and order option
- 3) Total installed length is independent of the process connections. Installed length according to DVGW (German Technical and Scientific Association for Gas and Water).

DN 350 to 900 (14 to 36")

Order code for "Housing", option A "Compact, aluminum, coated"

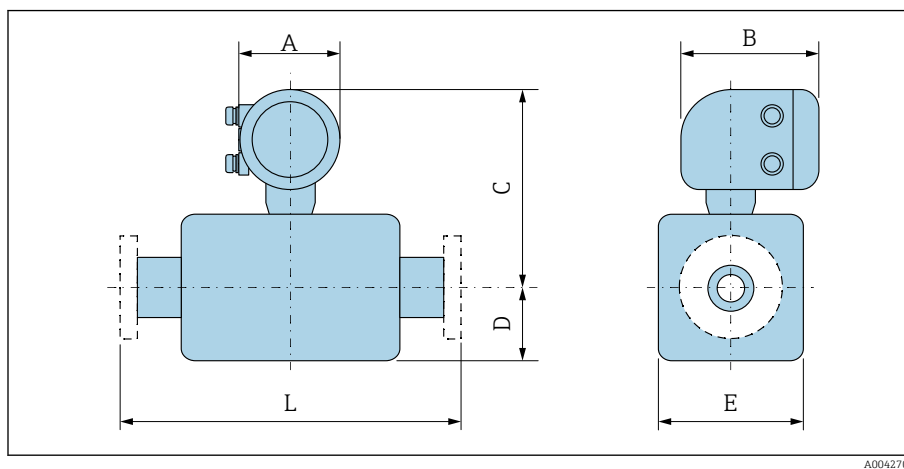

A0042708

DN		A ¹⁾	B	Order code for "Design"						L ³⁾	
				Options E, F			Option G				
				C ²⁾	D ²⁾	E ²⁾	C ²⁾	D ²⁾	E ²⁾		
[mm]	[in]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
350	14	139	178	457	245	490	–	–	–	550	
375	15	139	178	483	271	542	–	–	–	600	
400	16	139	178	483	271	542	–	–	–	600	
450	18	139	178	465	299	598	508	333	666	600 ⁴⁾	650 ⁵⁾
500	20	139	178	490	324	648	534	359	717	600 ⁴⁾	650 ⁵⁾
600	24	139	178	540	365	730	586	411	821	600 ⁴⁾	780 ⁵⁾
700	28	139	178	601	430	860	688	512	1024	700 ⁴⁾	910 ⁵⁾
750	30	139	178	639	467	934	688	512	1024	750 ⁴⁾	975 ⁵⁾
800	32	139	178	658	486	972	709	534	1065	800 ⁴⁾	1040 ⁵⁾
900	36	139	178	708	536	1072	786	610	1218	900 ⁴⁾	1170 ⁵⁾

1) Depending on the cable entry used: values up to + 30 mm


2) Reference values: depending on the pressure rating, design and order option

3) Total installed length is independent of the process connections. Installed length according to DVGW (German Technical and Scientific Association for Gas and Water).

4) Order code for "Design", option F "Fixed flange, short installed length"

5) Order code for "Design", option G "Fixed flange, long installed length"

Order code for "Housing", option M "Compact, polycarbonate"

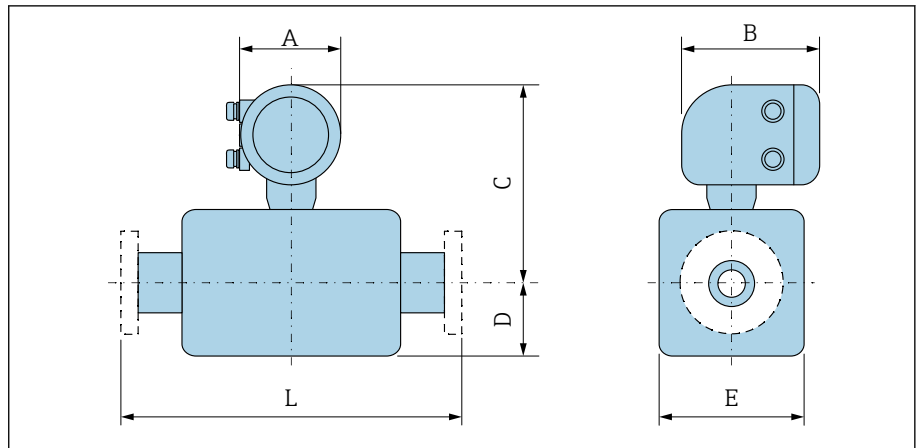

A0042708

DN		A ¹⁾	B	Order code for "Design"						L ³⁾	
				Options E, F			Option G				
				C ²⁾	D ²⁾	E ²⁾	C ²⁾	D ²⁾	E ²⁾		
[mm]	[in]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
350	14	132	172	454	245	490	–	–	–	550	
375	15	132	172	480	271	542	–	–	–	600	
400	16	132	172	480	271	542	–	–	–	600	
450	18	132	172	462	299	598	505	333	666	600 ⁴⁾	650 ⁵⁾
500	20	132	172	487	324	648	531	359	717	600 ⁴⁾	650 ⁵⁾
600	24	132	172	537	365	730	583	411	821	600 ⁴⁾	780 ⁵⁾
700	28	132	172	598	430	860	685	512	1024	700 ⁴⁾	910 ⁵⁾
750	30	132	172	636	467	934	685	512	1024	750 ⁴⁾	975 ⁵⁾
800	32	132	172	655	486	972	706	534	1065	800 ⁴⁾	1040 ⁵⁾
900	36	132	172	705	536	1072	783	610	1218	900 ⁴⁾	1170 ⁵⁾

1) Depending on the cable entry used: values up to + 30 mm

2) Reference values: depending on the pressure rating, design and order option


3) Total installed length is independent of the process connections. Installed length according to DVGW (German Technical and Scientific Association for Gas and Water).

4) Order code for "Design", option F "Fixed flange, short installed length"

5) Order code for "Design", option G "Fixed flange, long installed length"

DN 1000 to 3000 (40 to 120")

Order code for "Housing", option A "Compact, aluminum, coated"

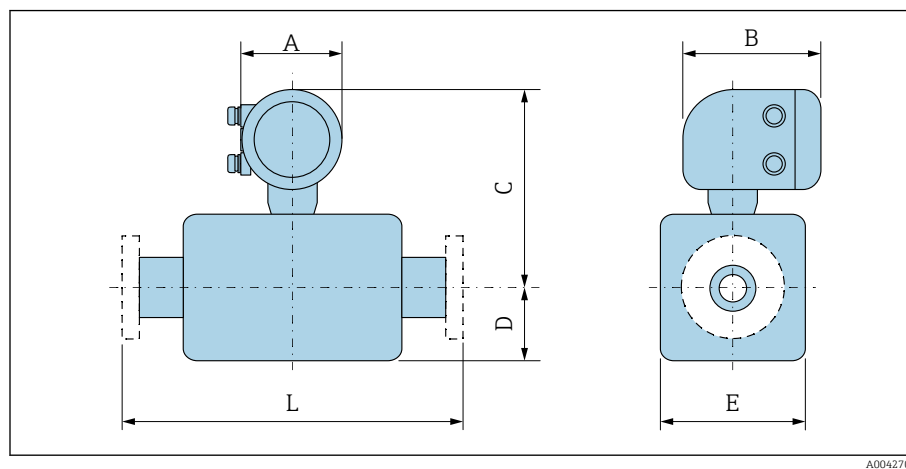

A0042708

DN		A ¹⁾	B	C ²⁾	D ²⁾	E ²⁾	L ³⁾	
[mm]	[in]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	
1000	40	139	178	759	582	1164	1000 ⁴⁾	1300 ⁵⁾
–	42	139	178	795	618	1236	1050 ⁴⁾	1365 ⁵⁾
1200	48	139	178	873	696	1392	1200 ⁴⁾	1560 ⁵⁾
–	54	139	178	986	809	1617	1350 ⁴⁾	1755 ⁵⁾
1400	–	139	178	986	809	1617	1400 ⁴⁾	1820 ⁵⁾
–	60	139	178	1086	909	1817	1500 ⁴⁾	1950 ⁵⁾
1600	–	139	178	1086	909	1817	1600 ⁴⁾	2080 ⁵⁾
–	66	139	178	1137	960	1919	1650 ⁴⁾	2145 ⁵⁾
1800	72	139	178	1193	1016	2032	1800 ⁴⁾	2340 ⁵⁾
–	78	139	178	1305	1127	2254	2000 ⁴⁾	2600 ⁵⁾
2000	–	139	178	1305	1127	2254	2000 ⁴⁾	2600 ⁵⁾
–	84	139	178	1405	1227	2454	2150 ⁴⁾	
2200	–	139	178	1405	1227	2454	2200 ⁴⁾	
–	90	139	178	1510	1227	2664	2300 ⁴⁾	
2400	–	139	178	1510	1332	2664	2400 ⁴⁾	
–	96	139	178	1609	1431	2861	2450 ⁴⁾	
–	102	139	178	1694	1516	3032	2600 ⁴⁾	
2600	–	139	178	1620	1442	2883	2600 ⁴⁾	
–	108	139	178	1781	1602	3204	2750 ⁴⁾	
2800	–	139	178	1725	1547	3093	2800 ⁴⁾	
–	114	139	178	1866	1688	3375	2900 ⁴⁾	
3000	–	139	178	1825	1647	3293	3000 ⁴⁾	
–	120	139	178	1952	1774	3547	3050 ⁴⁾	

1) Depending on the cable entry used: values up to + 30 mm


2) Reference values: depending on the pressure rating, design and order option

3) Total installed length is independent of the process connections. Installed length according to DVGW (German Technical and Scientific Association for Gas and Water).

4) Order code for "Design", option F "Fixed flange, short installed length"

5) Order code for "Design", option G "Fixed flange, long installed length"

Order code for "Housing", option M "Compact, polycarbonate"

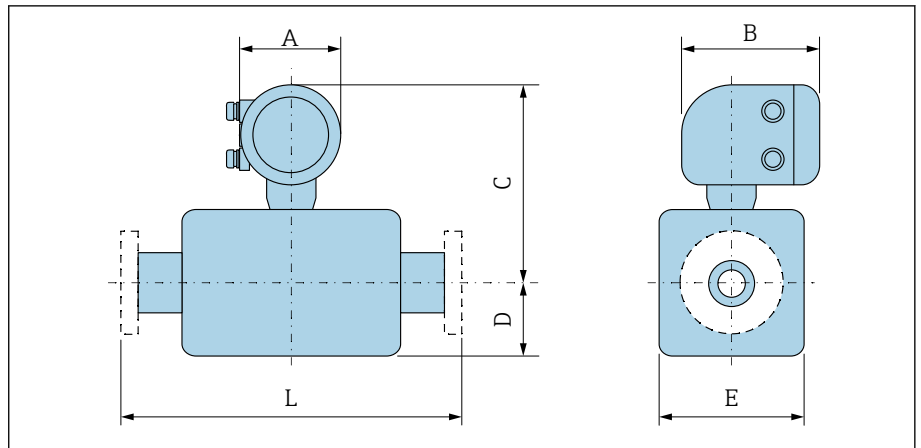

A0042708

DN		A ¹⁾	B	C ²⁾	D ²⁾	E ²⁾	L ³⁾	
[mm]	[in]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	
1000	40	132	172	756	582	1164	1000 ⁴⁾	1300 ⁵⁾
–	42	132	172	792	618	1236	1050 ⁴⁾	1365 ⁵⁾
1200	48	132	172	870	696	1392	1200 ⁴⁾	1560 ⁵⁾
–	54	132	172	983	809	1617	1350 ⁴⁾	1755 ⁵⁾
1400	–	132	172	983	809	1617	1400 ⁴⁾	1820 ⁵⁾
–	60	132	172	1083	909	1817	1500 ⁴⁾	1950 ⁵⁾
1600	–	132	172	1083	909	1817	1600 ⁴⁾	2080 ⁵⁾
–	66	132	172	1134	960	1919	1650	2145 ⁵⁾
1800	72	132	172	1190	1016	2032	1800 ⁴⁾	2340 ⁵⁾
–	78	132	172	1302	1127	2254	2000 ⁴⁾	2600 ⁵⁾
2000	–	132	172	1302	1127	2254	2000 ⁴⁾	2600 ⁵⁾
–	84	132	172	1402	1227	2454	2150 ⁴⁾	
2200	–	132	172	1402	1227	2454	2200 ⁴⁾	
–	90	132	172	1507	1227	2664	2300 ⁴⁾	
2400	–	132	172	1507	1332	2664	2400 ⁴⁾	
–	96	132	172	1606	1431	2861	2450 ⁴⁾	
–	102	132	172	1691	1516	3032	2600 ⁴⁾	
2600	–	132	172	1617	1442	2883	2600 ⁴⁾	
–	108	132	172	1778	1602	3204	2750 ⁴⁾	
2800	–	132	172	1722	1547	3093	2800 ⁴⁾	
–	114	132	172	1863	1688	3375	2900 ⁴⁾	
3000	–	132	172	1822	1647	3293	3000 ⁴⁾	
–	120	132	172	1949	1774	3547	3050 ⁴⁾	

1) Depending on the cable entry used: values up to + 30 mm

2) Reference values: depending on the pressure rating, design and order option


3) Total installed length is independent of the process connections. Installed length according to DVGW (German Technical and Scientific Association for Gas and Water).

4) Order code for "Design", option F "Fixed flange, short installed length"

5) Order code for "Design", option G "Fixed flange, long installed length"

Remote version

Transmitter remote version

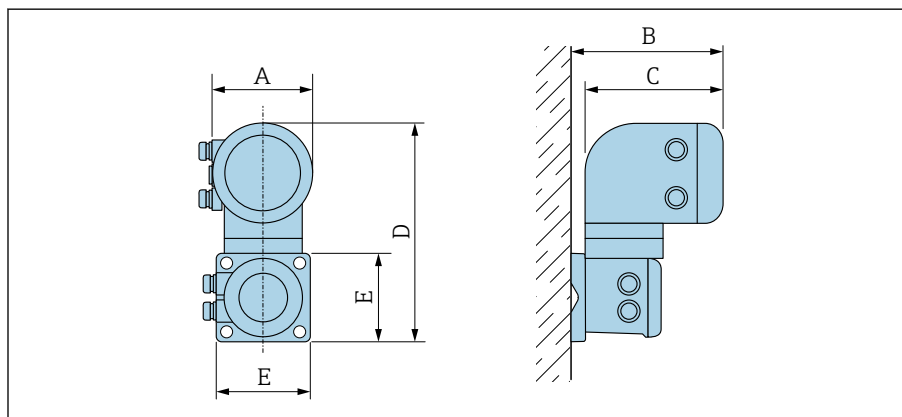


A0042715

Order code for "Housing"	A ¹⁾ [mm]	B [mm]	C [mm]	D [mm]	E [mm]
Option N "Remote, polycarbonate"	132	187	172	307	130
Option P "Remote, aluminum, coated"	139	185	178	309	130

1) Depending on the cable entry used: values up to + 30 mm

Sensor connection housing

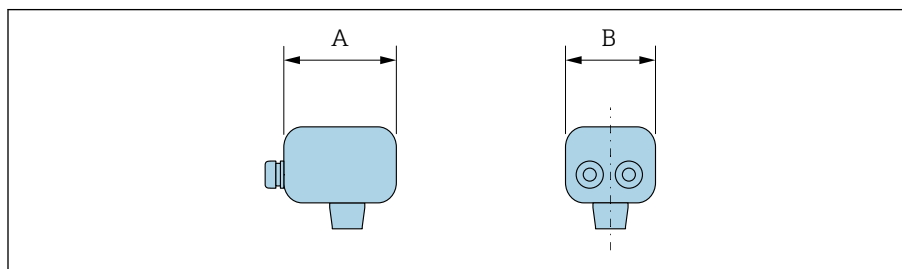

A0042716


Housing material	A ¹⁾ [mm]	B [mm]
Polycarbonate plastic ²⁾	113	112
Aluminum, coated	148	136

- 1) Depending on the cable entry used: values up to + 30 mm
 2) In conjunction with order code for "Sensor option", options CB, CC, CD, CE, C3

DN 25 to 300 (1 to 12") aluminum half-shell housing

Sensor with aluminum half-shell housing.

Sensor connection housing: aluminum, AlSi10Mg, coated

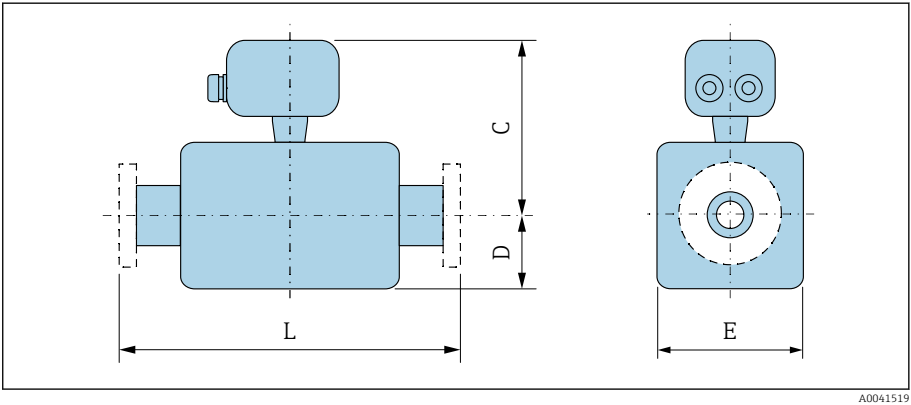

A0041519


DN		Order code for "Design"			
		Options D, E, H, I			
		C ¹⁾	D	E	L ²⁾
[mm]	[in]	[mm]	[mm]	[mm]	[mm]
25	1	197	84	120	200
32	–	197	84	120	200
40	1 ½	197	84	120	200
50	2	197	84	120	200
65	–	222	109	180	200
80	3	222	109	180	200
100	4	222	109	180	250
125	–	262	150	260	250
150	6	262	150	260	300
200	8	287	180	324	350
250	10	312	205	400	450
300	12	337	230	460	500

- 1) Reference values: depending on the pressure rating, design and order option
- 2) Total installed length is independent of the process connections. Installed length according to DVGW (German Technical and Scientific Association for Gas and Water).

DN 25 to 300 (1 to 12") fully welded housing

Sensor with fully welded carbon steel housing:

Order code for "Sensor option", options CB, CC, CD, CE, C3

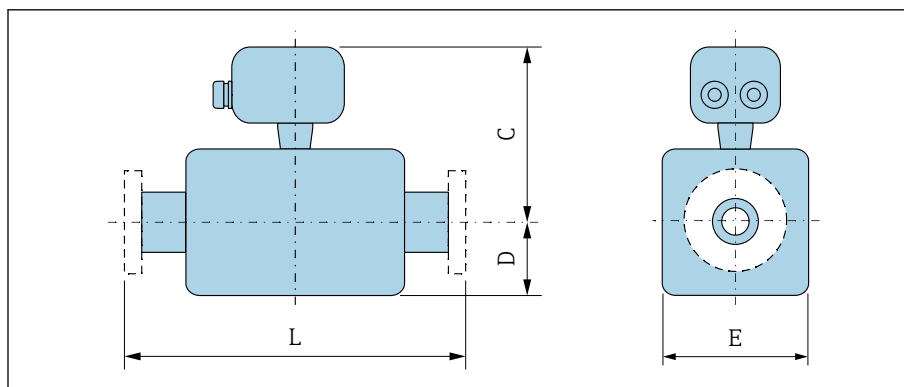


A0041519

DN		Order code for "Design"			
		Options A, E			
		C ¹⁾	D ¹⁾	E ¹⁾	L ²⁾
[mm]	[in]	[mm]	[mm]	[mm]	[mm]
25	1	189	70	140	200
32	–	189	70	140	200
40	1 ½	189	70	140	200
50	2	189	70	140	200
65	–	202	82	165	200
80	3	207	87	175	200
100	4	219	100	200	250
125	–	232	113	226	250
150	6	254	134	269	300
200	8	279	160	320	350
250	10	313	193	387	450
300	12	338	218	437	500

1) Reference values: depending on the pressure rating, design and order option

2) Total installed length is independent of the process connections. Installed length according to DVGW (German Technical and Scientific Association for Gas and Water).

DN 350 to 900 (14 to 36")

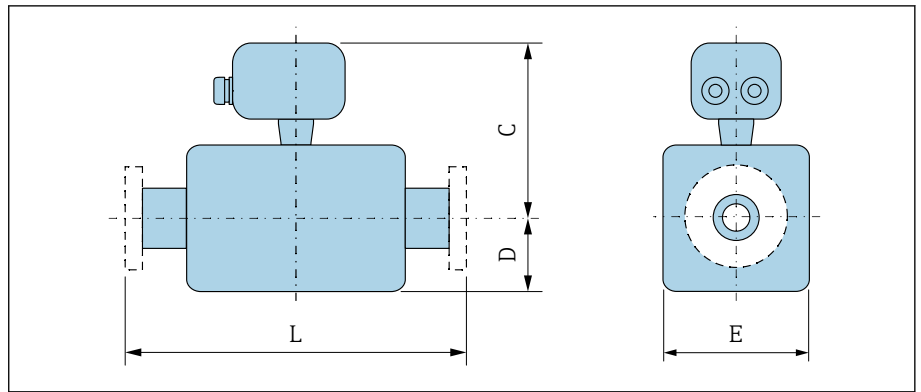


A0041519

DN		Order code for "Design"						L ²⁾	
		Options E, F			Option G				
		C ¹⁾	D ¹⁾	E ¹⁾	C ¹⁾	D ¹⁾	E ¹⁾		
[mm]	[in]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
350	14	395	245	490	–	–	–	550	
375	15	421	271	542	–	–	–	600	
400	16	421	271	542	–	–	–	600	
450	18	403	299	598	446	333	666	600 ³⁾	650 ⁴⁾
500	20	428	324	648	472	359	717	600 ³⁾	650 ⁴⁾
600	24	478	365	730	524	411	821	600 ³⁾	780 ⁴⁾
700	28	539	430	860	626	512	1024	700 ³⁾	910 ⁴⁾
750	30	577	467	934	626	512	1024	750 ³⁾	975 ⁴⁾
800	32	596	486	972	647	534	1065	800 ³⁾	1040 ⁴⁾
900	36	646	536	1072	724	610	1218	900 ³⁾	1170 ⁴⁾

- 1) Reference values: depending on the pressure rating, design and order option
- 2) Total installed length is independent of the process connections. Installed length according to DVGW (German Technical and Scientific Association for Gas and Water).
- 3) Order code for "Design", option F "Fixed flange, short installed length"
- 4) Order code for "Design", option G "Fixed flange, long installed length"

DN 1000 to 3000 (40 to 120")

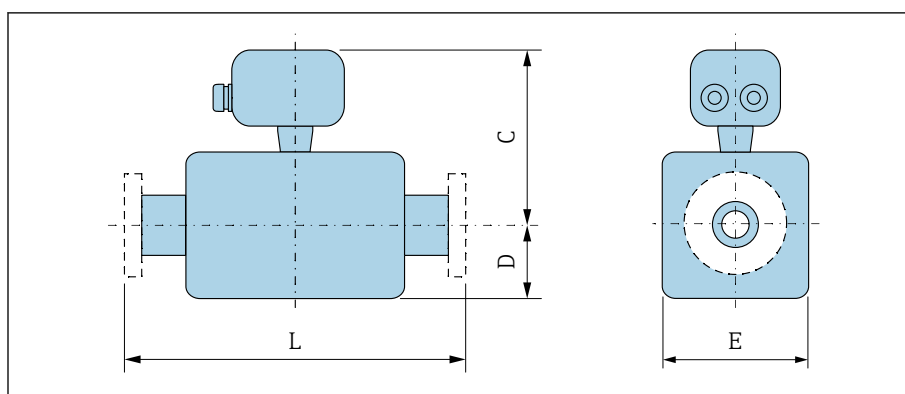

A0041519

DN		C ¹⁾	D ¹⁾	E ¹⁾	L ²⁾	
[mm]	[in]				[mm]	
1000	40	698	582	1164	1000 ³⁾	1300 ⁴⁾
–	42	734	618	1236	1050 ³⁾	1365 ⁴⁾
1200	48	812	696	1392	1200 ³⁾	1560 ⁴⁾
–	54	925	809	1617	1350 ³⁾	1755 ⁴⁾
1400	–	925	809	1617	1400 ³⁾	1820 ⁴⁾
–	60	1025	909	1817	1500 ³⁾	1950 ⁴⁾
1600	–	1025	909	1817	1600 ³⁾	2080 ⁴⁾
–	66	1076	960	1919	1650 ³⁾	2145 ⁴⁾
1800	72	1132	1016	2032	1800 ³⁾	2340 ⁴⁾
–	78	1244	1127	2254	2000 ³⁾	2600 ⁴⁾
2000	–	1244	1127	2254	2000 ³⁾	2600 ⁴⁾
–	84	1344	1227	2454	2150 ³⁾	
2200	–	1344	1227	2454	2200 ³⁾	
–	90	1449	1227	2664	2300 ³⁾	
2400	–	1449	1332	2664	2400 ³⁾	
–	96	1548	1431	2861	2450 ³⁾	
–	102	1633	1516	3032	2600 ³⁾	
2600	–	1559	1442	2883	2600 ³⁾	
–	108	1720	1602	3204	2750 ³⁾	
2800	–	1664	1547	3093	2800 ³⁾	
–	114	1805	1688	3375	2900 ³⁾	
3000	–	1764	1647	3293	3000 ³⁾	
–	120	1891	1774	3547	3050 ³⁾	

1) Reference values: depending on the pressure rating, design and order option

2) Total installed length is independent of the process connections. Installed length according to DVGW (German Technical and Scientific Association for Gas and Water).

3) Order code for "Design", option F "Fixed flange, short installed length"

4) Order code for "Design", option G "Fixed flange, long installed length"


Fixed flange

Flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 10

- Carbon steel: order code for "Process connection", option D2K
- Stainless steel: order code for "Process connection", option D2S

Surface roughness: EN 1092-1 Form B1 (DIN 2526 Form C), Ra 6.3 to 12.5 µm

E: Internal diameter depends on the liner → 66



A0041915


DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]
200	340	295	8 × Ø22	26
250	395	350	12 × Ø22	28
300	445	400	12 × Ø22	28
350	505	460	16 × Ø22	26
400	565	515	16 × Ø26	26
450	615	565	20 × Ø26	26
500	670	620	20 × Ø26	28
600	780	725	20 × Ø30	30
700	895	840	24 × Ø30	35
800	1015	950	24 × Ø33	38
900	1115	1050	28 × Ø33	38
1000	1230	1160	28 × Ø36	44
1200	1455	1380	32 × Ø39	55
1400	1675	1590	36 × Ø42	65
1600	1915	1820	40 × Ø48	75
1800	2115	2020	44 × Ø48	85
2000	2325	2230	48 × Ø48	90
2200	2550	2440	52 × Ø56	100
2400	2760	2650	56 × Ø56	110
2600	2960	2850	60 × Ø56	110
2800	3180	3070	64 × Ø56	124
3000	3405	3290	68 × Ø62	132

Flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 16

- Carbon steel: order code for "Process connection", option D3K
- Stainless steel: order code for "Process connection", option D3S

Surface roughness: EN 1092-1 Form B1 (DIN 2526 Form C), Ra 6.3 to 12.5 µm

E: Internal diameter depends on the liner → 66



A0041915


DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]
65	185	145	8 × Ø18	20
80	200	160	8 × Ø18	20
100	220	180	8 × Ø18	22
125	250	210	8 × Ø18	24
150	285	240	8 × Ø22	24
200	340	295	12 × Ø22	26
250	405	355	12 × Ø26	32
300	460	410	12 × Ø26	32
350	520	470	16 × Ø26	30
400	580	525	16 × Ø30	32
450	640	585	20 × Ø30	34
500	715	650	20 × Ø33	36
600	840	770	20 × Ø36	40
700	910	840	24 × Ø36	40
800	1025	950	24 × Ø39	41
900	1125	1050	28 × Ø39	48
1000	1255	1170	28 × Ø42	59
1200	1485	1390	32 × Ø48	78
1400	1685	1590	36 × Ø48	84
1600	1930	1820	40 × Ø56	102
1800	2130	2020	44 × Ø56	110
2000	2345	2230	48 × Ø62	124

Flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 25

- Carbon steel: order code for "Process connection", option D4K
- Stainless steel: order code for "Process connection", option D4S

Surface roughness: EN 1092-1 Form B1 (DIN 2526 Form C), Ra 6.3 to 12.5 µm

E: Internal diameter depends on the liner → 66



A0041915


DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]
200	360	310	12 × Ø26	32
250	425	370	12 × Ø30	36
300	485	430	16 × Ø30	40
350	555	490	16 × Ø33	38
400	620	550	16 × Ø36	40
450	670	600	20 × Ø36	46
500	730	660	20 × Ø36	48
600	845	770	20 × Ø39	48
700	960	875	24 × Ø42	50
800	1085	990	24 × Ø48	53
900	1185	1090	28 × Ø48	57
1000	1320	1210	28 × Ø56	63

Flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 40

- Carbon steel: order code for "Process connection", option D5K
- Stainless steel: order code for "Process connection", option D5S

Surface roughness: EN 1092-1 Form B1 (DIN 2526 Form C), Ra 6.3 to 12.5 µm

E: Internal diameter depends on the liner → 66.



A0041915


DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]
25	115	85	4 × Ø14	16
32	140	100	4 × Ø18	18
40	150	110	4 × Ø18	18
50	165	125	4 × Ø18	20
65	185	145	8 × Ø18	24
80	200	160	8 × Ø18	26
100	235	190	8 × Ø22	26
125	270	220	8 × Ø26	28
150	300	250	8 × Ø26	30

Flange according to ASME B16.5, Class 150

- Carbon steel: order code for "Process connection", option A1K
- Stainless steel: order code for "Process connection", option A1S

Surface roughness: Ra 6.3 to 12.5 µm

E: Internal diameter depends on the liner → 66



A0041915


DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]
25	108	79.2	4 × Ø16	12.6
40	127	98.6	4 × Ø16	15.9
50	152.4	120.7	4 × Ø19.1	17.5
80	190.5	152.4	4 × Ø19.1	22.3
100	228.6	190.5	8 × Ø19.1	22.3
150	279.4	241.3	8 × Ø22.4	23.8
200	342.9	298.5	8 × Ø22.4	26.8
250	406.4	362	12 × Ø25.4	29.6
300	482.6	431.8	12 × Ø25.4	30.2
350	535	476.3	12 × Ø28.6	35.4
400	595	539.8	16 × Ø28.6	37
450	635	577.9	16 × Ø31.8	40.1
500	700	635	20 × Ø31.8	43.3
600	815	749.3	20 × Ø34.9	48.1

Flange according to ASME B16.5, Class 300

- Carbon steel: order code for "Process connection", option A2K
- Stainless steel: order code for "Process connection", option A2S

Surface roughness: Ra 6.3 to 12.5 µm

E: Internal diameter depends on the liner →  66



A0041915


DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]
25	123.9	88.9	4 × Ø19.1	15.9
40	155.4	114.3	4 × Ø22.4	19
50	165.1	127	8 × Ø19.1	20.8
80	209.6	168.1	8 × Ø22.4	26.8
100	254	200.2	8 × Ø22.4	30.2
150	317.5	269.7	12 × Ø22.4	35

Flange according to JIS B2220, 10K

- Carbon steel: order code for "Process connection", option N3K
- Stainless steel: order code for "Process connection", option N3S

Surface roughness: Ra 6.3 to 12.5 µm

E: Internal diameter depends on the liner → 66



A0041915


DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]
50	155	120	4 × Ø19	16
65	175	140	4 × Ø19	18
80	185	150	8 × Ø19	18
100	210	175	8 × Ø19	18
125	250	210	8 × Ø23	20
150	280	240	8 × Ø23	22
200	330	290	12 × Ø23	22
250	400	355	12 × Ø25	24
300	445	400	16 × Ø25	24

Flange according to JIS B2220, 20K

- Carbon steel: order code for "Process connection", option N4K
- Stainless steel: order code for "Process connection", option N4S

Surface roughness: Ra 6.3 to 12.5 µm

E: Internal diameter depends on the liner →  66



A0041915


DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]
25	125	90	4 × Ø19	16
32	135	100	4 × Ø19	18
40	140	105	4 × Ø19	18
50	155	120	8 × Ø19	18
65	175	140	8 × Ø19	20
80	200	160	8 × Ø23	22
100	225	185	8 × Ø23	24
125	270	225	8 × Ø25	26
150	305	260	12 × Ø25	28
200	350	305	12 × Ø25	30
250	430	380	12 × Ø27	34
300	480	430	16 × Ø27	36

Flange according to AWWA, Class D

Order code for "Process connection", option W1K

Surface roughness: Ra 6.3 to 12.5 µm

E: Internal diameter depends on the liner → 66



A0041915


DN	DN		A	B	C	D
	[mm]	[in]				
700		28	927	863.6	28 × Ø35	33.4
750		30	984	914.4	28 × Ø35	35
800		32	1060	977.9	28 × Ø42	38.1
900		36	1168	1085.9	32 × Ø42	41.3
1000		40	1289	1200.2	36 × Ø42	41.3
-		42	1346	1257.3	36 × Ø42	44.5
1200		48	1511	1422.4	44 × Ø42	47.7
-		54	1683	1593.9	44 × Ø48	54
-		60	1855	1759	52 × Ø48	57.2
-		66	2032	1930.4	52 × Ø48	63.5
1800		72	2197	2095.5	60 × Ø48	66.7
-		78	2362	2260.6	64 × Ø54	69.9
-		84	2535	2425.7	64 × Ø54	73.1
-		90	2705	2717.8	68 × Ø60	76.2
-		96	2877	2755.9	68 × Ø60.3	82.55
-		102	3048	2908.3	68 × Ø66.7	82.55
-		108	3219	3067.0	68 × Ø66.7	85.73
-		114	3391	3219.5	68 × Ø73	88.90
-		120	3562	3371.8	68 × Ø73	88.90

Flange according to AS 2129, Tab. E

Order code for "Process connection", option M2K

Surface roughness: Ra 6.3 to 12.5 µm

E: Internal diameter depends on the liner → 66.



A0041915


DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]
80	185	146	4 × Ø18	12
100	215	178	8 × Ø18	13
150	280	235	8 × Ø22	17
200	335	292	8 × Ø22	19
250	405	356	12 × Ø22	22
300	455	406	12 × Ø26	25
350	525	470	12 × Ø26	30
400	580	521	12 × Ø26	32
450	640	584	16 × Ø26	35
500	705	641	16 × Ø26	38
600	825	756	16 × Ø33	48
700	910	845	20 × Ø33	51
750	995	927	20 × Ø36	54
800	1060	984	20 × Ø36	54
900	1175	1092	24 × Ø36	64
1000	1255	1175	24 × Ø39	67
1200	1490	1410	32 × Ø39	79

Flange according to AS 4087, PN 16

Order code for "Process connection", option M3K

Surface roughness: Ra 6.3 to 12.5 µm

E: Internal diameter depends on the liner → 66



A0041915

DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]
80	185	146	4 × Ø18	12
100	215	178	4 × Ø18	13
150	280	235	8 × Ø18	13
200	335	292	8 × Ø18	19
250	405	356	8 × Ø22	19
300	455	406	12 × Ø22	23
350	525	470	12 × Ø26	30
375	550	495	12 × Ø26	30
400	580	521	12 × Ø26	32
450	640	584	12 × Ø26	30
500	705	641	16 × Ø26	38
600	825	756	16 × Ø30	48
700	910	845	20 × Ø30	56
750	995	927	20 × Ø33	56
800	1060	984	20 × Ø36	56
900	1175	1092	24 × Ø36	66
1000	1255	1175	24 × Ø36	66
1200	1490	1410	32 × Ø36	76

Lap joint flange


Lap joint flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 10

- Carbon steel: order code for "Process connection", option D22
- Stainless steel: order code for "Process connection", option D24

Surface roughness (flange): Ra 6.3 to 12.5 µm

F: Internal diameter depends on the liner →  66

DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]
200	340	295	8 × Ø22	24	264
250	395	350	12 × Ø22	26	317
300	445	400	12 × Ø22	26	367




A0042254

Lap joint flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 16

- Carbon steel: order code for "Process connection", option D32
- Stainless steel: order code for "Process connection", option D34

Surface roughness (flange): Ra 6.3 to 12.5 µm

F: Internal diameter depends on the liner → 66




DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]
25	115	85	4 × Ø14	16	49
32	140	100	4 × Ø18	18	65
40	150	110	4 × Ø18	18	71
50	165	125	4 × Ø18	20	88
65	185	145	8 × Ø18	20	103
80	200	160	8 × Ø18	20	120
100	220	180	8 × Ø18	22	148
125	250	210	8 × Ø18	22	177
150	285	240	8 × Ø22	24	209
200	340	295	12 × Ø22	26	264
250	405	355	12 × Ø26	29	317
300	460	410	12 × Ø26	32	367

Lap joint flange according to ASME B16.5, Class 150

- Carbon steel: order code for "Process connection", option A12
- Stainless steel: order code for "Process connection", option A14

Surface roughness (flange): Ra 6.3 to 12.5 µm

F: Internal diameter depends on the liner →  66



A0042254

DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]
25	110	80	4 × Ø16	14	49
40	125	98	4 × Ø16	17.5	71
50	150	121	4 × Ø19	19	88
80	190	152	4 × Ø19	24	120
100	230	190	8 × Ø19	24	148
150	280	241	8 × Ø23	25	209
200	345	298	8 × Ø23	29	264
250	405	362	12 × Ø25	30	317
300	485	432	12 × Ø25	32	378


Lap joint flange, stamped plate

Lap joint flange, stamped plate in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 10

- Carbon steel: order code for "Process connection", option D21
- Stainless steel: order code for "Process connection", option D23

Surface roughness (flange): Ra 6.3 to 12.5 µm


F: Internal diameter depends on the liner → 66



DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]
25	115	85	4 x Ø13.5	16.5	49
32	140	100	4 x Ø17.5	17	65
40	150	110	4 x Ø17.5	16.5	71
50	165	125	4 x Ø17.5	18.5	88
65	185	145	4 x Ø17.5	20	103
80	200	160	8 x Ø17.5	23.5	120
100	220	180	8 x Ø17.5	24.5	148
125	250	210	8 x Ø17.5	24	177
150	285	240	8 x Ø21.5	25	209
200	340	295	8 x Ø21.5	27.5	264
250	405	350	12 x Ø21.5	30.5	317
300	445	400	12 x Ø21.5	34.5	367

Accessories

Protective cover

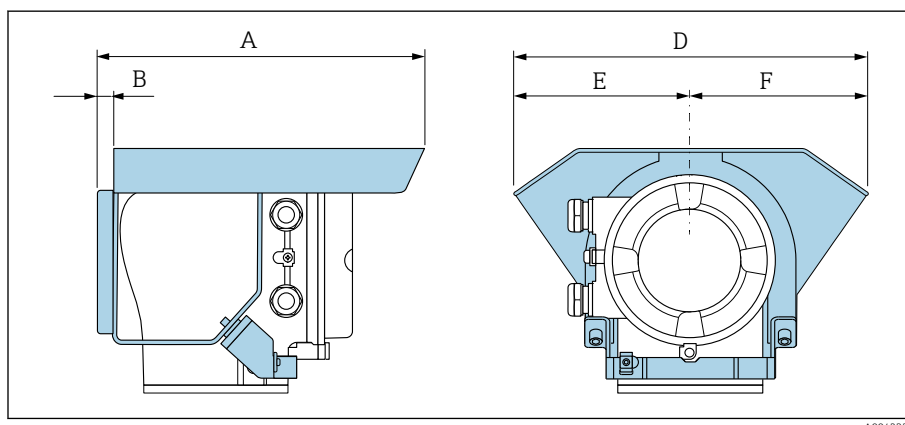

A0042332

A [mm]	B [mm]	D [mm]	E [mm]	F [mm]
257	12	280	140	140


Ground disks for flanges

DN 15 to 300 (½ to 12")		DN		Pressure rating	A	B	C ¹⁾	D	E	F
		[mm]	[in]		[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
		25	1"	2)	87.5	6.5	2	26	62	77.5
		32	1 ¼"	2)	94.5	6.5	2	35	80	87.5
		40	1 ½"	2)	103	6.5	2	41	82	101
		50	2"	2)	108	6.5	2	52	101	115.5
		65	2 ½"	2)	118	6.5	2	68	121	131.5
		80	3"	2)	135	6.5	2	80	131	154.5
		100	4"	2)	153	6.5	2	104	156	186.5
		125	5"	2)	160	6.5	2	130	187	206.5
		150	6"	2)	184	6.5	2	158	217	256
		200	8"	2)	205	6.5	2	206	267	288
		250	10"	2)	240	6.5	2	260	328	359
		300	12"	PN 10 PN 16 Cl. 150	273	6.5	2	312	375	413


A0042332

1) Material thickness

2) In the case of DN 25 to 250, ground disks can be used for all the flange standards/pressure ratings which can be supplied in the standard version.

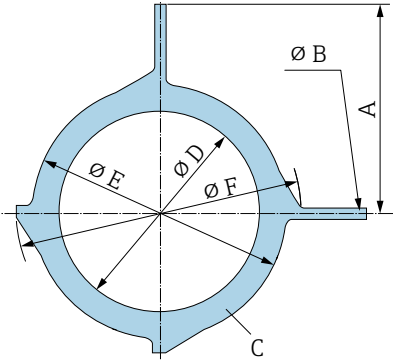DN 300 to 600 (12 to 24")		DN		Rating	A	B	C ¹⁾	D	E	F
		[mm]	[in]							
		300	12"	PN 25 JIS 10K JIS 20K	268	9	2	310	375	404
		350	14"	PN 6 PN 10 PN 16	365	9	2	343	420	479
		375	15"	PN 16	395	9	2	393	461	523
		400	16"	PN 6 PN 10 PN 16	395	9	2	393	470	542
		450	18"	PN 6 PN 10 PN 16	417	9	2	439	525	583
		500	20"	PN 6 PN 10 PN 16	460	9	2	493	575	650
		600	24"	PN 6 PN 10 PN 16	522	9	2	593	676	766

1) Material thickness

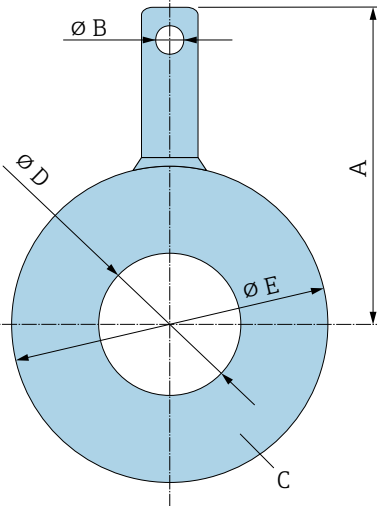DN 700 to 1200 (28 to 48")		DN		Rating	A	B	C ¹⁾	D	E
		[mm]	[in]						
		700	28"	PN 6 PN10 PN16 Cl, D	18.11 18.9 19.29 19.45	6.4	2	697 693 687 693	786 813 807 832
		750	30"	Cl, D	20.59	6.4	2	743	833
		800	32"	PN 6 PN 10 PN 16 Cl, D	520 540 550 561	6.4	2	799 795 789 795	893 920 914 940
		900	36"	PN 6 PN 10 PN 16 Cl, D	570 590 595 615	6.4	2	897 893 886 893	993 1020 1014 1048
		1000	40"	PN 6 PN 10 PN 16 Cl, D	620 650 660 675	6.4	2	999 995 988 995	1093 1127 1131 1163
		-	42"	PN 6	704	6.4	2	1044 1044	1220
		1200	48"	PN 6 PN 10 PN 16 Cl, D	733 760 786 775	6.4	2	1203 1196 1196 1188	1310 1344 1385 1345

1) Material thickness

Dimensions in US units


Compact version	102
DN 25 to 300 (1 to 12")	102
DN 350 to 900 (14 to 36")	104
DN 1000 to 3000 (40 to 120")	106
Remote version	108
Transmitter remote version	108
Sensor connection housing	108
DN 25 to 300 (1 to 12") aluminum half-shell housing	109
DN 25 to 300 (1 to 12") fully welded housing	110
DN 350 to 900 (14 to 36")	111
DN 1000 to 3000 (40 to 120")	112
Fixed flange	113
Flange according to ASME B16.5, Class 150	113
Flange according to ASME B16.5, Class 300	113
Flange according to AWWA, Cl. D	114
Lap joint flange	115
Lap joint flange according to ASME B16.5, Class 150	115
Accessories	116
Protective cover	116
Ground disks for flanges	116

Compact version

DN 25 to 300 (1 to 12")

Order code for "Housing", option A "Compact, aluminum, coated"

Sensor with aluminum half-shell housing

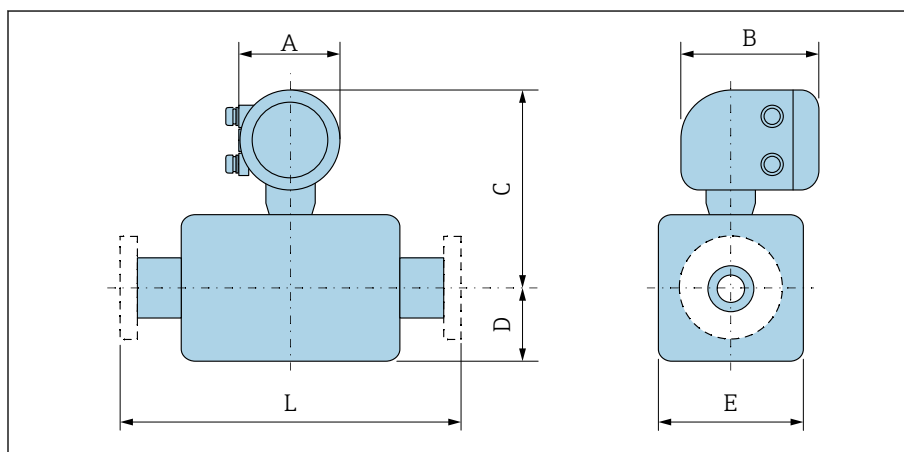

A0042708

DN		A ¹⁾	B	Order code for "Design"			L ³⁾
				Options D, E, H, I			
[mm]	[in]	[in]	[in]	C ²⁾	D ²⁾	E ²⁾	[in]
25	1	5.47	7.01	10.16	3.31	4.72	7.87
32	–	5.47	7.01	10.16	3.31	4.72	7.87
40	1 ½	5.47	7.01	10.16	3.31	4.72	7.87
50	2	5.47	7.01	10.16	3.31	4.72	7.87
65	–	5.47	7.01	11.14	4.29	7.09	7.87
80	3	5.47	7.01	11.14	4.29	7.09	7.87
100	4	5.47	7.01	11.14	4.29	7.09	9.84
125	–	5.47	7.01	12.72	5.91	10.24	9.84
150	6	5.47	7.01	12.72	5.91	10.24	11.81
200	8	5.47	7.01	13.7	7.09	12.76	13.78
250	10	5.47	7.01	14.69	8.07	15.75	17.72
300	12	5.47	7.01	15.67	9.06	18.11	19.69


1) Depending on the cable entry used: values up to +1.18 in

2) Reference values: depending on the pressure rating, design and order option

3) Total installed length is independent of the process connections. Installed length according to DVGW (German Technical and Scientific Association for Gas and Water).

Order code for "Housing", option M "Compact, polycarbonate"

Sensor with aluminum half-shell housing

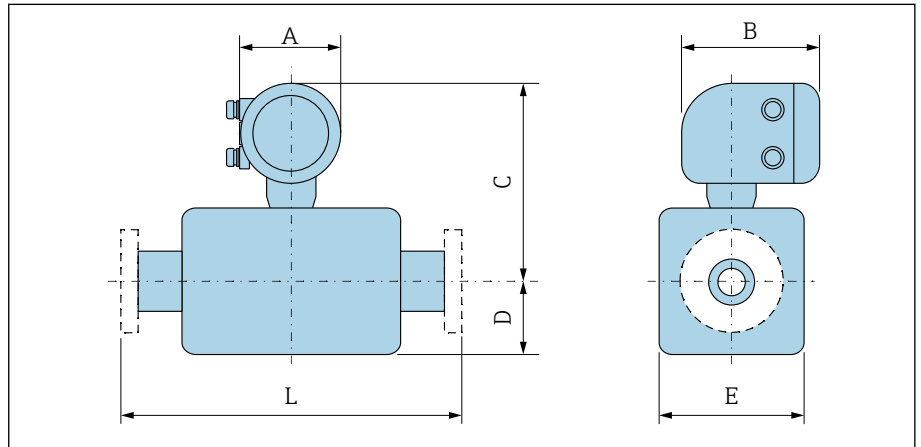


A0042708

DN		A ¹⁾	B	Order code for "Design"			L ³⁾
				Options D, E, H, I			
				C ²⁾	D ²⁾	E ²⁾	
[mm]	[in]	[in]	[in]	[in]	[in]	[in]	[in]
25	1	5.2	6.77	10.04	3.31	4.72	7.87
32	–	5.2	6.77	10.04	3.31	4.72	7.87
40	1 ½	5.2	6.77	10.04	3.31	4.72	7.87
50	2	5.2	6.77	10.04	3.31	4.72	7.87
65	–	5.2	6.77	11.02	4.29	7.09	7.87
80	3	5.2	6.77	11.02	4.29	7.09	7.87
100	4	5.2	6.77	11.02	4.29	7.09	9.84
125	–	5.2	6.77	12.6	5.91	10.24	9.84
150	6	5.2	6.77	12.6	5.91	10.24	11.81
200	8	5.2	6.77	13.58	7.09	12.76	13.78
250	10	5.2	6.77	14.57	8.07	15.75	17.72
300	12	5.2	6.77	15.55	9.06	18.11	19.69

1) Depending on the cable entry used: values up to +1.18 in

2) Reference values: depending on the pressure rating, design and order option

3) Total installed length is independent of the process connections. Installed length according to DVGW (German Technical and Scientific Association for Gas and Water).

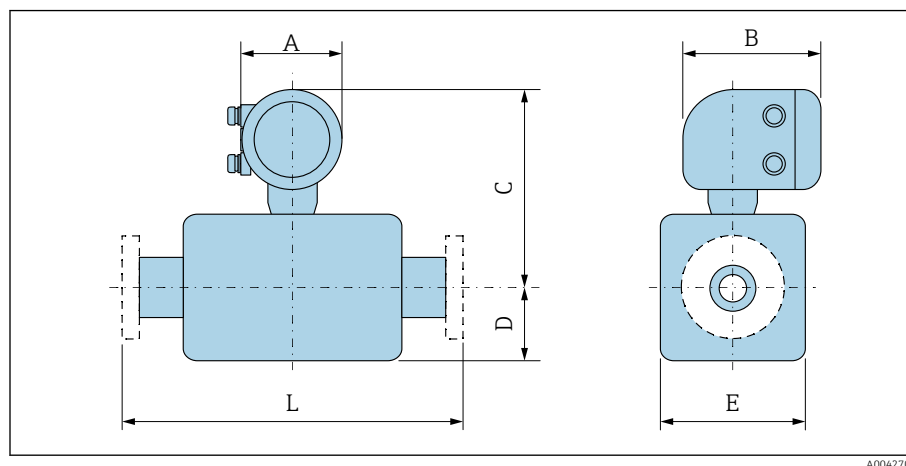DN 350 to 900 (14 to 36")*Order code for "Housing", option A "Compact, aluminum, coated"*

A0042708

DN		A ¹⁾	B	Order code for "Design"						L ³⁾	
				Options E, F			Option G				
				C ²⁾	D ²⁾	E ²⁾	C ²⁾	D ²⁾	E ²⁾		
[mm]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]
350	14	5.47	7.01	17.99	9.65	19.29	–	–	–	21.65	
375	15	5.47	7.01	19.02	10.67	21.34	–	–	–	23.62	
400	16	5.47	7.01	19.02	10.67	21.34	–	–	–	23.62	
450	18	5.47	7.01	18.31	11.77	23.54	20	13.11	26.22	23.62 ⁴⁾	25.59 ⁵⁾
500	20	5.47	7.01	19.29	12.76	25.51	21.02	14.13	28.23	23.62	25.59
600	24	5.47	7.01	21.26	14.37	28.74	23.07	16.18	32.32	23.62	30.71
700	28	5.47	7.01	23.66	16.93	33.86	27.09	20.16	40.31	27.56	35.83
750	30	5.47	7.01	25.16	18.39	36.77	27.09	20.16	40.31	29.53	38.39
800	32	5.47	7.01	25.91	19.13	38.27	27.91	21.02	41.93	31.5	40.94
900	36	5.47	7.01	27.87	21.1	42.2	30.94	24.02	47.95	35.43	46.06

1) Depending on the cable entry used: values up to +1.18 in


2) Reference values: depending on the pressure rating, design and order option

3) Total installed length is independent of the process connections. Installed length according to DVGW (German Technical and Scientific Association for Gas and Water).

4) Order code for "Design", option F "Fixed flange, short installed length"

5) Order code for "Design", option G "Fixed flange, long installed length"

Order code for "Housing", option M "Compact, polycarbonate"

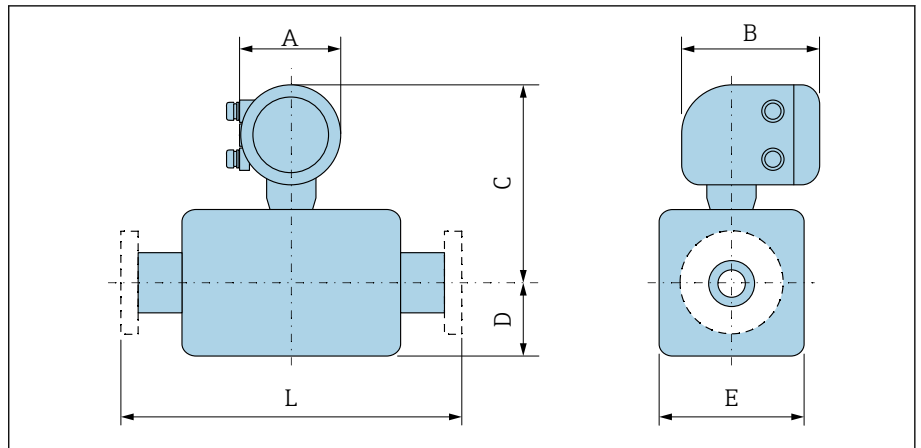

A0042708

DN		A ¹⁾	B	Order code for "Design"						L ³⁾	
				Options E, F			Option G				
				C ²⁾	D ²⁾	E ²⁾	C ²⁾	D ²⁾	E ²⁾		
[mm]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]
350	14	5.2	6.77	17.87	9.65	19.29	–	–	–	21.65	
375	15	5.2	6.77	18.9	10.67	21.34	–	–	–	23.62	
400	16	5.2	6.77	18.9	10.67	21.34	–	–	–	23.62	
450	18	5.2	6.77	18.19	11.77	23.54	19.88	13.11	26.22	23.62 ⁴⁾	25.59 ⁵⁾
500	20	5.2	6.77	19.17	12.76	25.51	20.91	14.13	28.23	23.62	25.59
600	24	5.2	6.77	21.14	14.37	28.74	22.95	16.18	32.32	23.62	30.71
700	28	5.2	6.77	23.54	16.93	33.86	26.97	20.16	40.31	27.56	35.83
750	30	5.2	6.77	25.04	18.39	36.77	26.97	20.16	40.31	29.53	38.39
800	32	5.2	6.77	25.79	19.13	38.27	27.8	21.02	41.93	31.5	40.94
900	36	5.2	6.77	27.76	21.1	42.2	30.83	24.02	47.95	35.43	46.06

1) Depending on the cable entry used: values up to +1.18 in

2) Reference values: depending on the pressure rating, design and order option


3) Total installed length is independent of the process connections. Installed length according to DVGW (German Technical and Scientific Association for Gas and Water).

4) Order code for "Design", option F "Fixed flange, short installed length"

5) Order code for "Design", option G "Fixed flange, long installed length"

DN 1000 to 3000 (40 to 120")

Order code for "Housing", option A "Compact, aluminum, coated"

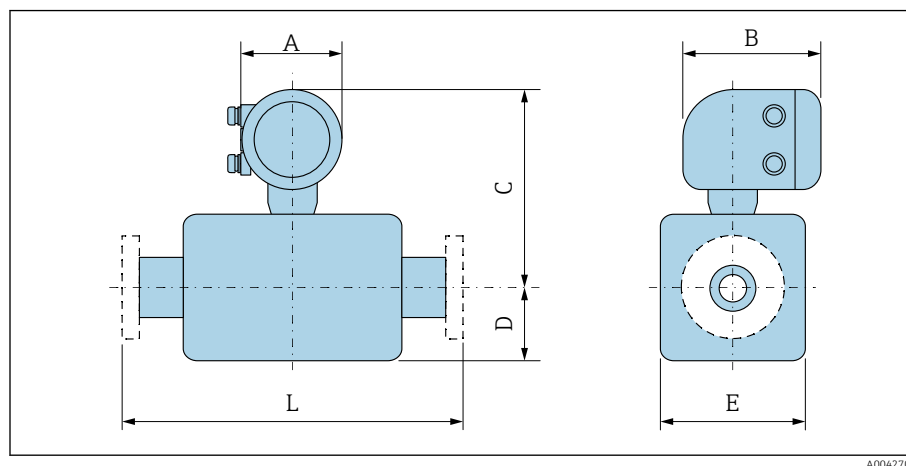

DN		A ¹⁾	B	C ²⁾	D ²⁾	E ²⁾	L ³⁾	
[mm]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	
1000	40	5.47	7.01	29.88	22.91	45.83	39.37 ⁴⁾	51.18 ⁵⁾
–	42	5.47	7.01	31.3	24.33	48.66	41.34	53.74
1200	48	5.47	7.01	34.37	27.4	54.8	47.24	61.42
–	54	5.47	7.01	38.82	31.85	63.66	53.15	69.09
1400	–	5.47	7.01	38.82	31.85	63.66	55.12	71.65
–	60	5.47	7.01	42.76	35.79	71.54	59.06	76.77
1600	–	5.47	7.01	42.76	35.79	71.54	62.99	81.89
–	66	5.47	7.01	44.76	37.8	75.55	64.96	84.45
1800	72	5.47	7.01	46.97	40	80	70.87	92.13
–	78	5.47	7.01	51.38	44.37	88.74	78.74	102.36
2000	–	5.47	7.01	51.38	44.37	88.74	78.74	102.36
–	84	5.47	7.01	55.31	48.31	96.61	84.65	
2200	–	5.47	7.01	55.31	48.31	96.61	86.61	
–	90	5.47	7.01	59.45	48.31	104.88	90.55	
2400	–	5.47	7.01	59.45	52.44	104.88	94.49	
–	96	5.47	7.01	63.35	56.34	112.64	96.46	
–	102	5.47	7.01	66.69	59.69	119.37	102.36	
2600	–	5.47	7.01	63.78	56.77	113.50	102.36	
–	108	5.47	7.01	70.12	63.07	126.14	108.27	
2800	–	5.47	7.01	67.91	60.91	121.77	110.24	
–	114	5.47	7.01	73.46	66.46	132.87	114.17	
3000	–	5.47	7.01	71.85	64.84	129.65	118.11	
–	120	5.47	7.01	76.85	69.84	139.65	120.08	

1) Depending on the cable entry used: values up to +1.18 in


2) Reference values: depending on the pressure rating, design and order option

3) Total installed length is independent of the process connections. Installed length according to DVGW (German Technical and Scientific Association for Gas and Water).

4) Order code for "Design", option F "Fixed flange, short installed length"

5) Order code for "Design", option G "Fixed flange, long installed length"

Order code for "Housing", option M "Compact, polycarbonate"

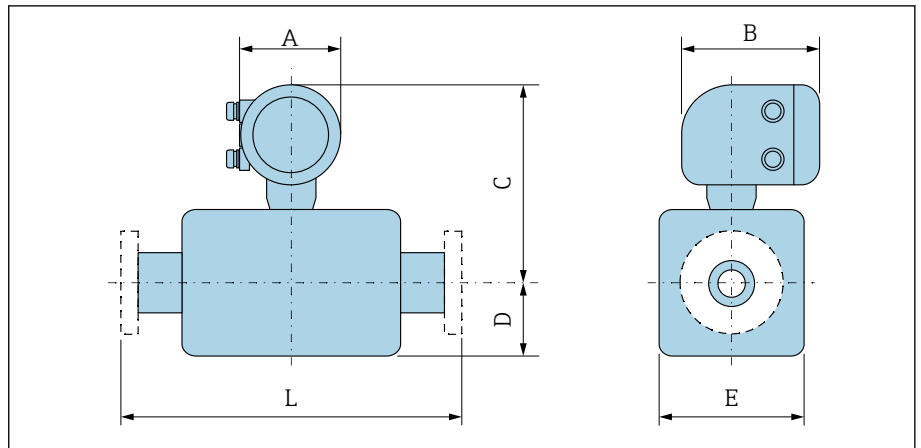

A0042708

DN		A ¹⁾	B	C ²⁾	D	E	L ³⁾	
[mm]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	
1000	40	5.2	6.77	29.76	22.91	45.83	39.37 ⁴⁾	51.18 ⁵⁾
–	42	5.2	6.77	31.18	24.33	48.66	41.34	53.74
1200	48	5.2	6.77	34.25	27.4	54.8	47.24	61.42
–	54	5.2	6.77	38.7	31.85	63.66	53.15	69.09
1400	–	5.2	6.77	38.7	31.85	63.66	55.12	71.65
–	60	5.2	6.77	42.64	35.79	71.54	59.06	76.77
1600	–	5.2	6.77	42.64	35.79	71.54	62.99	81.89
–	66	5.2	6.77	44.65	37.8	75.55	64.96	84.45
1800	72	5.2	6.77	46.85	40	80	70.87	92.13
–	78	5.2	6.77	51.26	44.37	88.74	78.74	102.36
2000	–	5.2	6.77	51.26	44.37	88.74	78.74	102.36
–	84	5.2	6.77	55.2	48.31	96.61	84.65	
2200	–	5.2	6.77	55.2	48.31	96.61	86.61	
–	90	5.2	6.77	59.33	48.31	104.88	90.55	
2400	–	5.2	6.77	59.33	52.44	104.88	94.49	
–	96	5.47	7.01	63.47	56.34	112.64	96.46	
–	102	5.47	7.01	66.81	59.69	119.37	102.36	
2600	–	5.47	7.01	63.9	56.77	113.50	102.36	
–	108	5.47	7.01	70.24	63.07	126.14	108.27	
2800	–	5.47	7.01	68.03	60.91	121.77	110.24	
–	114	5.47	7.01	73.58	66.46	132.87	114.17	
3000	–	5.47	7.01	71.97	64.84	129.65	118.11	
–	120	5.47	7.01	76.97	69.84	139.65	120.08	

1) Depending on the cable entry used: values up to +1.18 in

2) Reference values: depending on the pressure rating, design and order option


3) Total installed length is independent of the process connections. Installed length according to DVGW (German Technical and Scientific Association for Gas and Water).

4) Order code for "Design", option F "Fixed flange, short installed length"

5) Order code for "Design", option G "Fixed flange, long installed length"

Remote version

Transmitter remote version

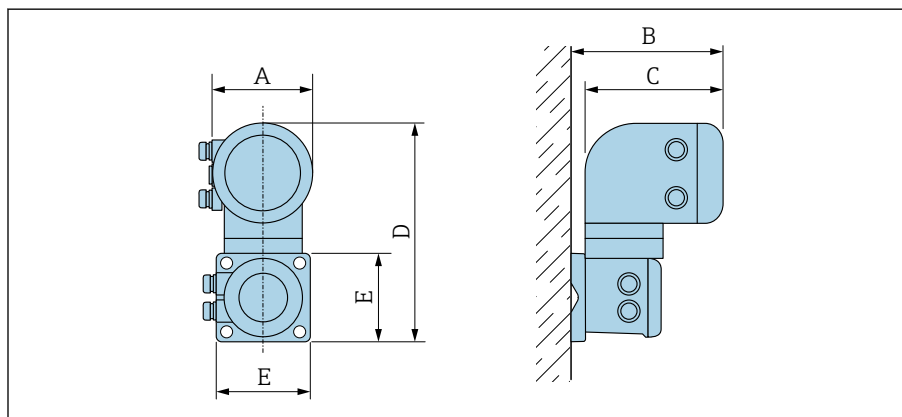


A0042715

Order code for "Housing"	A ¹⁾ [in]	B [in]	C [in]	D [in]	E [in]
Option N "Remote, polycarbonate"	5.2	7.36	6.77	12.09	5.12
Option P "Remote, aluminum, coated"	5.47	7.28	7.01	12.17	5.12

1) Depending on the cable entry used: values up to +1.18 in

Sensor connection housing

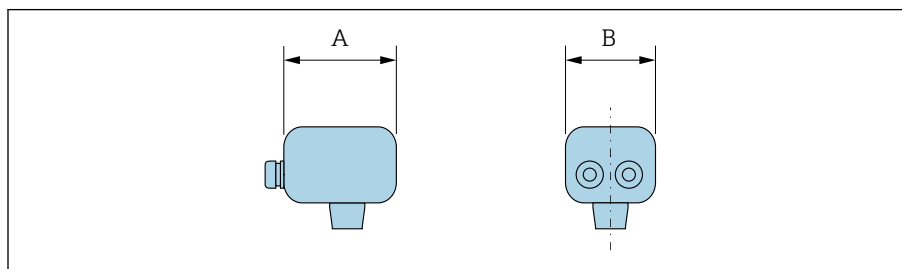

A0042716

Housing material	A ¹⁾ [in]	B [in]
Polycarbonate plastic ²⁾	4.45	4.41
Aluminum, coated	5.83	5.35


1) Depending on the cable entry used: values up to + 1.18 in

2) In conjunction with order code for "Sensor option", options CB, CC, CD, CE, C3

DN 25 to 300 (1 to 12") aluminum half-shell housing

Sensor with aluminum half-shell housing.

Sensor connection housing: aluminum, AlSi10Mg, coated

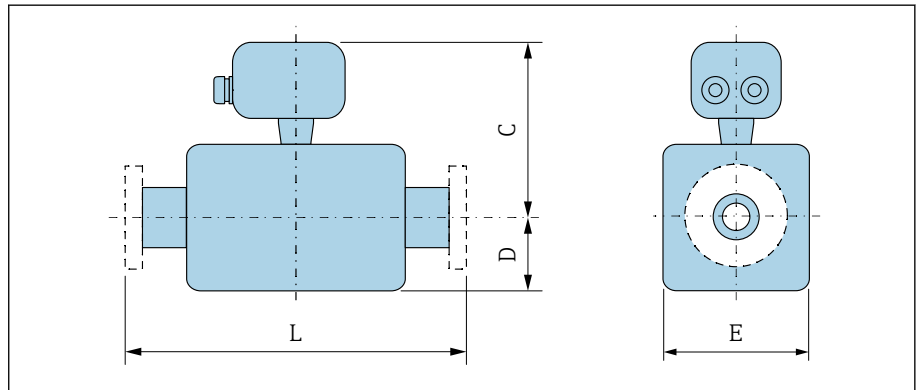

A0041519

DN		Order code for "Design"			
		Options D, E, H, I			
		C ¹⁾	D	E	L ²⁾
[mm]	[in]	[in]	[in]	[in]	[in]
25	1	7.76	3.31	4.72	7.87
32	–	7.76	3.31	4.72	7.87
40	1 ½	7.76	3.31	4.72	7.87
50	2	7.76	3.31	4.72	7.87
65	–	8.74	4.29	7.09	7.87
80	3	8.74	4.29	7.09	7.87
100	4	8.74	4.29	7.09	9.84
125	–	10.31	5.91	10.24	9.84
150	6	10.31	5.91	10.24	11.81
200	8	11.3	7.09	12.76	13.78
250	10	12.28	8.07	15.75	17.72
300	12	13.27	9.06	18.11	19.69


1) Reference values: depending on the pressure rating, design and order option

2) Total installed length is independent of the process connections. Installed length according to DVGW (German Technical and Scientific Association for Gas and Water).

DN 25 to 300 (1 to 12") fully welded housing

Sensor with fully welded carbon steel housing:

Order code for "Sensor option", options CB, CC, CD, CE, C3

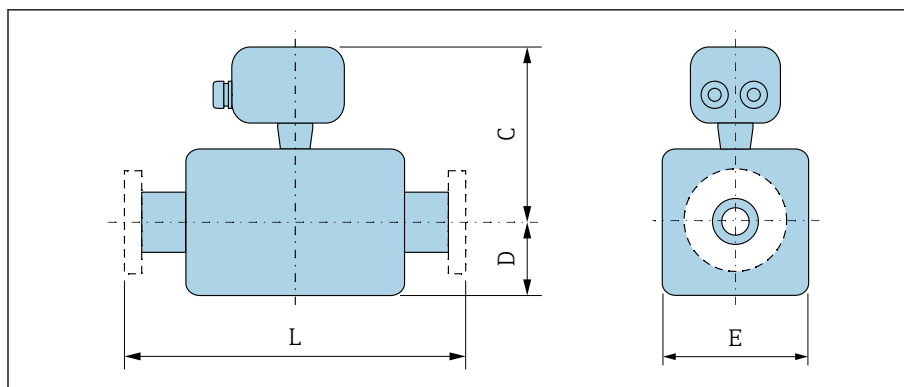


A0041519

DN		Order code for "Design"			
		Options A, E			
		C ¹⁾	D ¹⁾	E ¹⁾	L ²⁾
[mm]	[in]	[in]	[in]	[in]	[in]
25	1	7.44	2.76	5.51	7.87
32	–	7.44	2.76	5.51	7.87
40	1 ½	7.44	2.76	5.51	7.87
50	2	7.44	2.76	5.51	7.87
65	–	7.95	3.23	6.5	7.87
80	3	8.15	3.43	6.89	7.87
100	4	8.62	3.94	7.87	9.84
125	–	9.13	4.45	8.9	9.84
150	6	10	5.28	10.59	11.81
200	8	10.98	6.3	12.6	13.78
250	10	12.32	7.6	15.24	17.72
300	12	13.31	8.58	17.2	19.69

1) Reference values: depending on the pressure rating, design and order option

2) Total installed length is independent of the process connections. Installed length according to DVGW (German Technical and Scientific Association for Gas and Water).

DN 350 to 900 (14 to 36")

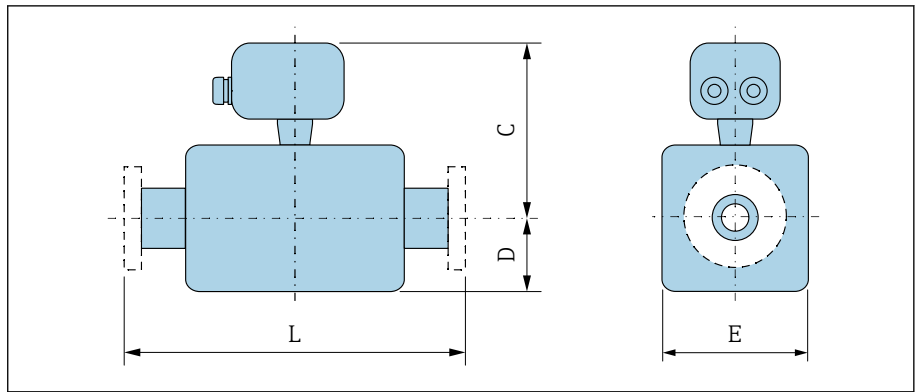


A0041519

DN		Order code for "Design"						L ²⁾	
		Options E, F			Option G				
		C ¹⁾	D	E	C	D	E		
[mm]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]
350	14	15.55	9.65	19.29	–	–	–	21.65	
375	15	16.57	10.67	21.34	–	–	–	23.62	
400	16	16.57	10.67	21.34	–	–	–	23.62	
450	18	15.87	11.77	23.54	17.56	13.11	26.22	23.62 ³⁾	25.59 ⁴⁾
500	20	16.85	12.76	25.51	18.58	14.13	28.23	23.62	25.59
600	24	18.82	14.37	28.74	20.63	16.18	32.32	23.62	30.71
700	28	21.22	16.93	33.86	24.65	20.16	40.31	27.56	35.83
750	30	22.72	18.39	36.77	24.65	20.16	40.31	29.53	38.39
800	32	23.46	19.13	38.27	25.47	21.02	41.93	31.5	40.94
900	36	25.43	21.1	42.2	28.5	24.02	47.95	35.43	46.06

- 1) Reference values: depending on the pressure rating, design and order option
- 2) Total installed length is independent of the process connections. Installed length according to DVGW (German Technical and Scientific Association for Gas and Water).
- 3) Order code for "Design", option F "Fixed flange, short installed length"
- 4) Order code for "Design", option G "Fixed flange, long installed length"

DN 1000 to 3000 (40 to 120")

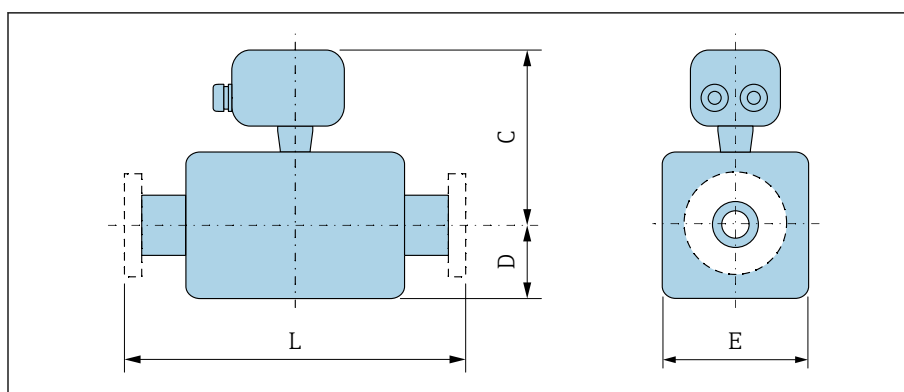

A0041519

DN		C ¹⁾	D ¹⁾	E ¹⁾	L ²⁾	
[mm]	[in]				[in]	
1000	40	27.48	22.91	45.83	39.37 ³⁾	51.18 ⁴⁾
–	42	28.9	24.33	48.66	41.34	53.74
1200	48	31.97	27.4	54.8	47.24	61.42
–	54	36.42	31.85	63.66	53.15	69.09
1400	–	36.42	31.85	63.66	55.12	71.65
–	60	40.35	35.79	71.54	59.06	76.77
1600	–	40.35	35.79	71.54	62.99	81.89
–	66	42.36	37.8	75.55	64.96	84.45
1800	72	44.57	40	80	70.87	92.13
–	78	48.98	44.37	88.74	78.74	102.36
2000	–	48.98	44.37	88.74	78.74	102.36
–	84	52.91	48.31	96.61	84.65	
2200	–	52.91	48.31	96.61	86.61	
–	90	57.05	48.31	104.88	90.55	
2400	–	57.05	52.44	104.88	94.49	
–	96	60.95	56.34	112.64	96.46	
–	102	64.29	59.69	119.37	102.36	
2600	–	61.38	56.77	113.50	102.36	
–	108	67.72	63.07	126.14	108.27	
2800	–	65.51	60.91	121.77	110.24	
–	114	71.06	66.46	132.87	114.17	
3000	–	69.45	64.84	129.65	118.11	
–	120	74.45	69.84	139.65	120.08	

1) Reference values: depending on the pressure rating, design and order option

2) Total installed length is independent of the process connections. Installed length according to DVGW (German Technical and Scientific Association for Gas and Water).

3) Order code for "Design", option F "Fixed flange, short installed length"

4) Order code for "Design", option G "Fixed flange, long installed length"


Fixed flange

Flange according to ASME B16.5, Class 150

- Carbon steel: order code for "Process connection", option A1K
- Stainless steel: order code for "Process connection", option A1S

Surface roughness: Ra 250 to 492 µin

E: Internal diameter depends on the liner → 66



A0041915


DN [in]	A [in]	B [in]	C [in]	D [in]
1	4.25	3.12	4 × Ø0.63	0.5
1 ½	5	3.88	4 × Ø0.63	0.63
2	6	4.75	4 × Ø0.75	0.69
3	7.5	6	4 × Ø0.75	0.88
4	9	7.5	8 × Ø0.75	0.88
6	11	9.5	8 × Ø0.88	0.94
8	13.5	11.75	8 × Ø0.88	1.06
10	16	14.25	12 × Ø1	1.17
12	19	17	12 × Ø1	1.19
14	21.06	18.75	12 × Ø1.13	1.39
16	23.43	21.25	16 × Ø1.13	1.46
18	25	22.75	16 × Ø1.25	1.58
20	27.56	25	20 × Ø1.25	1.7
24	32.09	29.5	20 × Ø1.37	1.89

Flange according to ASME B16.5, Class 300

- Carbon steel: order code for "Process connection", option A2K
- Stainless steel: order code for "Process connection", option A2S

Surface roughness: Ra 250 to 492 µin

E: Internal diameter depends on the liner → 66



A0041915


DN [in]	A [in]	B [in]	C [in]	D [in]
1	4.88	3.5	4 × Ø0.75	0.63
1 ½	6.12	4.5	4 × Ø0.88	0.75
2	6.5	5	8 × Ø0.75	0.82
3	8.25	6.62	8 × Ø0.88	1.06
4	10	7.88	8 × Ø0.88	1.19
6	12.5	10.62	12 × Ø0.88	1.38

Flange according to AWWA, Cl. D

Order code for "Process connection", option W1K

Surface roughness: Ra 250 to 492 µin

E: Internal diameter depends on the liner → 66



A0041915

DN [in]	A [in]	B [in]	C [in]	D [in]
28	36.5	34	28 × Ø1.38	1.31
30	38.74	36	28 × Ø1.38	1.38
32	41.73	38.5	28 × Ø1.65	1.5
36	45.98	42.75	32 × Ø1.65	1.63
40	50.75	47.25	36 × Ø1.65	1.63
42	52.99	49.5	36 × Ø1.65	1.75
48	59.49	56	44 × Ø1.65	1.88
54	66.26	62.75	44 × Ø1.89	2.13
60	73.03	69.25	52 × Ø1.89	2.25
66	80	76	52 × Ø1.89	2.5
72	86.5	82.5	60 × Ø1.89	2.63
78	92.99	89	64 × Ø2.13	2.75
84	99.8	95.5	64 × Ø2.13	2.88
90	106.5	107	68 × Ø2.36	3
96	113.27	108.50	68 × Ø2.37	3.25
102	120.00	114.50	68 × Ø2.63	3.25
108	126.73	120.75	68 × Ø2.63	3.38
114	133.50	126.75	68 × Ø2.87	3.50
120	140.24	132.75	68 × Ø2.87	3.50


Lap joint flange

Lap joint flange according to ASME B16.5, Class 150

- **Carbon steel:** order code for "Process connection", option A12
- **Stainless steel:** order code for "Process connection", option A14


Surface roughness (flange): Ra 248 to 492 µin

F: Internal diameter depends on the liner → 66

	DN [in]	A [in]	B [in]	C [in]	D [in]	E [in]
	1	4.33	3.15	4 × Ø0.63	0.55	1.93
	1 ½	4.92	3.86	4 × Ø0.63	0.69	2.8
	2	5.91	4.76	4 × Ø0.75	0.75	3.46
	3	7.48	5.98	4 × Ø0.75	0.94	4.72
	4	9.06	7.48	8 × Ø0.75	0.94	5.83
	6	11.02	9.49	8 × Ø0.91	0.98	8.23
	8	13.58	11.73	8 × Ø0.91	1.14	10.39
	10	15.94	14.25	12 × Ø0.98	1.18	12.48
	12	19.09	17.01	12 × Ø0.98	1.26	14.88

Accessories

Protective cover

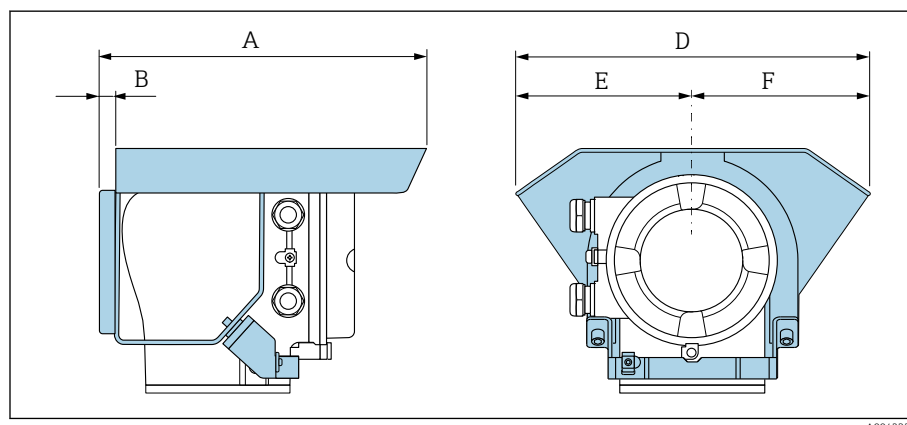

A0042332


A [in]	B [in]	D [in]	E [in]	F [in]
10.12	0.47	11.02	5.51	5.51

Ground disks for flanges


DN 15 to 300 (½ to 12")			DN		Pressure rating	A [in]	B [in]	C ¹⁾ [in]	D [in]	E [in]	F [in]
			[mm]	[in]							
			25	1"	2)	3.44	0.26	0.08	1.02	2.44	3.05
			32	1 ¼"	2)	3.72	0.26	0.08	1.38	3.15	3.44
			40	1 ½"	2)	4.06	0.26	0.08	1.61	3.23	3.98
			50	2"	2)	4.25	0.26	0.08	2.05	3.98	4.55
			65	2 ½"	2)	4.65	0.26	0.08	2.68	4.76	5.18
			80	3"	2)	5.31	0.26	0.08	3.15	5.16	6.08
			100	4"	2)	6.02	0.26	0.08	4.09	6.14	7.34
			125	5"	2)	6.3	0.26	0.08	5.12	7.36	8.13
			150	6"	2)	7.24	0.26	0.08	6.22	8.54	10.08
			200	8"	2)	8.07	0.26	0.08	8.11	10.51	11.34
			250	10"	2)	9.45	0.26	0.08	10.24	12.91	14.13
			300	12"	PN 10 PN 16 Cl. 150	10.75	0.26	0.08	12.28	14.76	16.26

A0042332

- 1) Material thickness
 2) In the case of DN 1 to 10", ground disks can be used for all the flange standards/pressure ratings which can be supplied in the standard version.

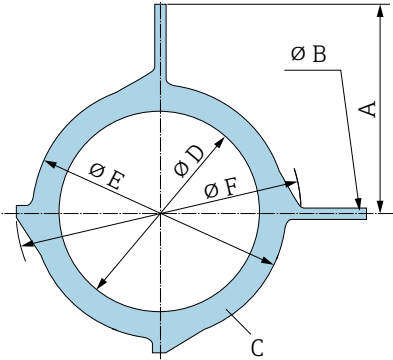DN 300 to 600 (12 to 24")		DN		Rating	A	B	C ¹⁾	D	E	F
		[mm]	[in]							
		300	12"	PN 25 JIS 10K JIS 20K	10.55	0.35	0.08	12.2	14.76	15.91
		350	14"	PN 6 PN 10 PN 16	14.37	0.35	0.08	13.5	16.54	18.86
		375	15"	PN 16	15.55	0.35	0.08	15.47	18.15	20.59
		400	16"	PN 6 PN 10 PN 16	15.55	0.35	0.08	15.47	18.5	21.34
		450	18"	PN 6 PN 10 PN 16	16.42	0.35	0.08	17.28	20.67	22.95
		500	20"	PN 6 PN 10 PN 16	18.11	0.35	0.08	19.41	22.64	25.59
		600	24"	PN 6 PN 10 PN 16	20.55	0.35	0.08	23.35	26.61	30.16

1) Material thickness

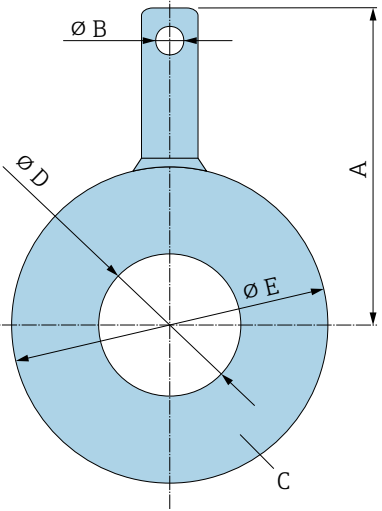DN 700 to 1200 (28 to 48")		DN		Rating	A	B	C ¹⁾	D	E
		[mm]	[in]						
		700	28"	PN 6 PN10 PN16 Cl, D	18.11 18.9 19.29 19.45	0.25	0.08	27.44 27.28 27.05 27.28	30.94 32.01 31.77 32.76
		750	30"	Cl, D	20.59	0.25	0.08	29.25	32.8
		800	32"	PN 6 PN 10 PN 16 Cl, D	20.47 21.26 21.65 22.09	0.25	0.08	31.46 31.3 31.06 31.3	35.16 36.22 35.98 37.01
		900	36"	PN 6 PN 10 PN 16 Cl, D	22.44 23.23 23.43 24.21	0.25	0.08	35.31 35.16 34.88 35.16	39.09 40.16 39.92 41.26
		1000	40"	PN 6 PN 10 PN 16 Cl, D	24.41 25.59 25.98 26.57	0.25	0.08	39.33 39.17 38.9 39.17	43.03 44.37 44.53 45.79
		-	42"	PN 6	27.72	0.25	0.08	41.1	48.03
		1200	48"	PN 6 PN 10 PN 16 Cl, D	28.86 29.92 30.94 30.51	0.25	0.08	47.36 47.09 47.09 46.77	51.57 52.91 54.53 52.95

1) Material thickness


Local display

Operating concept	120
Operating options	120
Operating tools	121

Operating concept

Operation method	- Operation via local display with touch screen. - Operation via SmartBlue App.
Menu structure	Operator-oriented menu structure for user-specific tasks: - Diagnostics - Application - System - Guidance - Language
Commissioning	- Commissioning via a guided menu (Commissioning wizard). - Menu guidance with interactive help function for individual parameters.
Reliable operation	- Operation in local language. - Uniform operating philosophy in device and in the SmartBlue App. - Write protection - When electronics modules are replaced: configurations are transferred using the T-DAT Backup device memory. The device memory contains process data, device data and the event logbook. No reconfiguration is necessary.
Diagnostic behavior	Efficient diagnostic behavior increases measurement availability: - Open troubleshooting measures via local display and SmartBlue App. - Diverse simulation options. - Logbook of events that have occurred.

Operating options

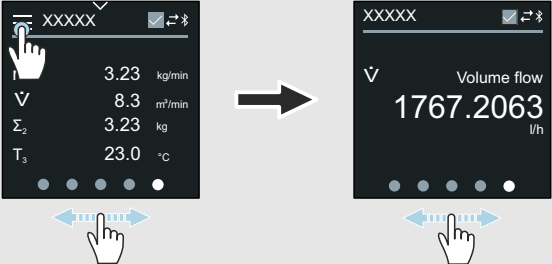Local display	 Display elements: - LCD touch screen - Depends on the orientation, automatic alignment of local display. - Configuration of display format for measured variables and status variables. Operating elements: - Touch screen - Local display can also be accessed in the hazardous area.
SmartBlue App	- The SmartBlue App allows the user to put devices into operation and operate them. - Based on Bluetooth. - No separate driver required. - Available for mobile handheld terminals, tablets and smartphones. - Suitable for convenient and secure access to devices in hard-to-reach locations or in hazardous areas. - Can be used within a 20 m (65.6 ft) radius of the device. - Encrypted and secure data transmission. - No data loss during commissioning and maintenance. - Diagnostic information and process information in real time.

Operating tools

Operating tools	Operating unit	Interface	Additional information
DeviceCare SFE100	▪ Notebook ▪ PC ▪ Tablet with Microsoft Windows system	▪ CDI service interface ▪ Fieldbus protocol	Innovation brochure IN01047S
FieldCare SFE500	▪ Notebook ▪ PC ▪ Tablet with Microsoft Windows system	▪ CDI service interface ▪ Fieldbus protocol	Operating Instructions BA00027S and BA00059S
SmartBlue App	▪ Devices with iOS: iOS9.0 or higher ▪ Devices with Android: Android 4.4 KitKat or higher	Bluetooth	Endress+HauserSmartBlue App: ▪ Google Playstore (Android) ▪ iTunes Apple Shop (iOS devices)
Device Xpert	Field Xpert SFX 100/350/370	HART fieldbus protocol	Operating Instructions BA01202S

Certificates and approvals

Non-Ex approval	124
Pressure Equipment Directive	124
Drinking water approval	124
Pharmaceutical compatibility	124
HART certification	124
Radio approval	124
Additional approvals	124
Other standards and guidelines	124

Non-Ex approval

- cSAus
- EAC
- UK
- KC

Pressure Equipment Directive

- CRN
- PED Cat. II/III

Drinking water approval

- ACS
- KTW/W270
- NSF 61
- WRAS BS 6920

Pharmaceutical compatibility

- FDA
- USP Class VI
- TSE/BSE Certificate of Suitability

HART certification

The device is certified and registered by the FieldComm Group. The measuring system meets all the requirements of the following specifications:

- Certified according to HART 7
- The device can also be operated with certified devices of other manufacturers (interoperability).

Radio approval

The device has radio approvals.

Additional approvals

VDS (for stationary fire extinguishing systems)

Other standards and guidelines

- IEC/EN 60529
Degrees of protection provided by enclosures (IP code)
- IEC/EN 60068-2-6
Environmental influences: Test procedure - Test Fc: vibrate (sinusoidal)
- IEC/EN 60068-2-31
Environmental influences: Test procedure - Test Ec: shocks due to rough handling, primarily for devices.
- IEC/EN 61010-1
Safety requirements for electrical equipment for measurement, control and laboratory use - general requirements.
- CAN/CSA-C22.2 No. 61010-1-12
Safety Requirements for Electrical Equipment for Measurement, Control and Laboratory Use - Part 1 General Requirements.
- IEC/EN 61326
Emission in accordance with Class A requirements. Electromagnetic compatibility (EMC requirements)
- ANSI/ISA-61010-1 (82.02.01)
Safety Requirements for Electrical Equipment for Measurement, Control and Laboratory Use - Part 1 General Requirements.
- NAMUR NE 21
Electromagnetic compatibility (EMC) of industrial process and laboratory control equipment.

- NAMUR NE 32
Data retention in the event of a power failure in field and control instruments with microprocessors.
- NAMUR NE 43
Standardization of the signal level for the breakdown information of digital transmitters with analog output signal.
- NAMUR NE 53
Software of field devices and signal-processing devices with digital electronics.
- NAMUR NE 105
Specifications for integrating fieldbus devices in engineering tools for field devices.
- NAMUR NE 107
Self-monitoring and diagnosis of field devices.
- NAMUR NE 131
Requirements for field devices for standard applications.
- ETSI EN 300 328
Guidelines for 2.4 GHz radio components
- EN 301489
Electromagnetic compatibility and radio spectrum matters (ERM).

Application packages

Use	128
Heartbeat Verification + Monitoring	128

Use

Many different application packages are available to enhance the functionality of the device. Such packages might be needed to address safety aspects or specific application requirements.

The application packages can be ordered with the device or subsequently from Endress+Hauser. Detailed information on the relevant order code is available from your local Endress+Hauser sales organization or on the product page of the Endress+Hauser website: www.endress.com.

Heartbeat Verification + Monitoring

Heartbeat Verification

Availability depends on the product structure.

Meets the requirement for traceable verification to DIN ISO 9001:2008 Chapter 7.6 a) "Control of monitoring and measuring equipment":

- Functional testing in the installed state without interrupting the process.
- Traceable verification results on request, including a report.
- Simple testing process with local operation or other operating interfaces.
- Clear measuring point assessment (pass/fail) with high test coverage within the framework of manufacturer specifications.
- Extension of calibration intervals according to operator's risk assessment.

Heartbeat Monitoring

Availability depends on the product structure.

Heartbeat Monitoring continuously supplies data, which are characteristic of the measuring principle, to an external condition monitoring system for the purpose of preventive maintenance or process analysis. These data enable the operator to:

- Draw conclusions - using these data and other information - about the impact the process influences, e.g. corrosion, abrasion, formation of buildup, have on the measuring performance over time.
- Schedule servicing in time.
- Monitor the process quality or product quality, e.g. gas pockets.

Accessories

Device-specific accessories	130
Communication-specific accessories	131
Service-specific accessory	131
System components	132

Device-specific accessories

Transmitter

Accessories	Description	Order number
Proline 10 transmitter	 Installation Instructions EA01350D	5XBBXX-*...*
Weather protection cover	Protects the device from weather exposure:  Installation Instructions EA01351D	71502730
Connecting cable	Can be ordered with the device. The following cable lengths are available: order code for "Cable, sensor connection" ■ 5 m (16 ft) ■ 10 m (32 ft) ■ 20 m (65 ft) ■ User-configurable cable length (m or ft)  Max. cable length: 200 m (660 ft)	DK5013-*...*
Ground cable	1 ground cable set for potential equalization, consisting of 2 ground cables	

Sensor

Accessories	Description
Ground disks	Ground medium in lined measuring pipes.  Installation Instructions EA00070D

Communication-specific accessories

Accessories	Description
Commubox FXA195 USB/HART modem	Intrinsically safe HART communication with FieldCare and FieldXpert  Technical Information TI00404F
Commubox FXA291	Connects the Endress+Hauser devices with the CDI interface (= Endress+Hauser Common Data Interface) to the USB interface of a personal computer or laptop.  Technical Information TI405C/07
HART Loop Converter HMX50	Is used to evaluate and convert dynamic HART process variables to analog current signals or limit values.  - Technical Information TI00429F - Operating Instructions BA00371F
Fieldgate FXA42	Transmission of measured values from connected 4 to 20 mA analog and digital devices.  - Technical Information TI01297S - Operating Instructions BA01778S - Product page: www.endress.com/fxa42
Field Xpert SMT70	Tablet PC for the configuration of the device. Enables mobile Plant Asset Management to manage the devices with a digital communication interface. Suitable for Zone 2.  - Technical Information TI01342S - Operating Instructions BA01709S - Product page: www.endress.com/smt70
Field Xpert SMT77	Tablet PC for the configuration of the device. Enables mobile Plant Asset Management to manage the devices with a digital communication interface. Suitable for Zone 1.  - Technical Information TI01418S - Operating Instructions BA01923S - Product page: www.endress.com/smt77

Service-specific accessory

Accessories	Description	Order number
Applicator	Software for selecting and sizing Endress+Hauser devices.	https://portal.endress.com/webapp/applicator
W@M Life Cycle Management	- Information platform with software applications and services - Supports the entire life cycle of the facility.	www.endress.com/lifecyclemanagement
FieldCare	FDT-based plant asset management software from Endress+Hauser. Management and configuration of Endress+Hauser devices.  Operating Instructions BA00027S and BA00059S	- Device driver: www.endress.com → Download Area - CD-ROM (contact Endress+Hauser) - DVD (contact Endress+Hauser)
DeviceCare	Software for connecting and configuring Endress+Hauser devices.  Innovation brochure IN01047S	- Device driver: www.endress.com → Download Area - CD-ROM (contact Endress+Hauser) - DVD (contact Endress+Hauser)

System components

Accessories	Description
Memograph M	Graphic data manager: ▪ Record measured values ▪ Monitor limit values ▪ Analyze measuring points  ▪ Technical Information TI00133R ▪ Operating Instructions BA00247R
iTEMP	Temperature transmitter: ▪ Measure the absolute pressure and gauge pressure of gases, vapors and liquids ▪ Read the medium temperature  "Fields of Activity" document FA00006T



info@lennotech.com Tel. +31-152-610-900
www.lennotech.com Fax. +31-152-616-289